

Moniteau School District
Maintenance Department
Dassa McKinney Elementary School
Water Treatment Facility
Monthly Operations Report
December 2021

Dassa McKinney Elementary School Water Treatment Facility											
Month	Date	Day	PH	Iron	Cl2 Free	Cl2 Total	Hardness	Meter Reading	Operator	Time	Notes
	1	Wed	8.7	0.02	0.46	0.58	2.07	12984800	JEFF R	3:00P	4300
	2	Thurs	8.7	0.01	0.57	0.63	2.24	12989300	JEFF R	3:00P	4500
	3	Fri	8.7	0.03	0.63	0.71	2.30	12994100	JEFF R	3:30P	4800
	4	Sat									
	5	Sun									
	6	Mon	8.7	0.02	0.63	0.69	2.44	12998500	JEFF R	3:30P	4400
	7	Tues	8.7	0.03	0.60	0.67	2.87	13003100	JEFF R	4:30P	4600
	8	Wed	8.7	0.04	0.78	0.88	2.82	13007600	JEFF R	3:00P	4500
	9	Thurs	8.7	0.02	0.80	0.86	2.78	13012100	JEFF R	3:30P	—
	10	Fri	8.7	0.03	0.82	0.89	2.71	13016700	JEFF R	3:30P	9100
	11	Sat									
	12	Sun									
	13	Mon	8.7	0.04	0.62	0.71	2.89	13021300	JEFF R	3:30P	4600
	14	Tues	8.7	0.00	0.64	0.72	2.99	13026300	JEFF R	3:30P	5000
	15	Wed	8.7	0.02	0.69	0.79	3.27	13031000	JEFF R	4:00P	4700
	16	Thurs	8.7	0.04	0.78	0.89	3.85	13035600	JEFF R	3:30P	4600
	17	Fri	8.7	0.02	0.75	0.83	2.81	13040600	JEFF R	4:00P	5000
	18	Sat									
	19	Sun									
	20	Mon	8.7	0.00	0.59	0.62	3.90	13044800	JEFF R	3:00P	4200
	21	Tues	8.7	0.00	0.57	0.61	2.85	13049500	JEFF R	3:00P	4700
	22	Wed	8.7	0.03	0.75	0.84	2.66	13053900	JEFF R	3:00P	4400
	23	Thurs	8.7	0.02	0.78	0.88	2.92	13054400	JEFF R	1:30P	500
	24	Fri	8.7	0.02	0.75	0.81	2.71	13054400	JEFF C	5:00Am	
	25	Sat									
	26	Sun									
	27	Mon	8.7	0.02	0.48	0.53	2.75	13054500	JEFF C	6:00Am	
	28	Tues	8.7	0.02	0.45	0.48	2.72	13054600	JEFF C	1:00Pm	
	29	Wed									
	30	Thurs									
	31	Fri						13054700			

Meter Reading on 11/30/21 - 12980500



1803 Philadelphia Street
Indiana, PA 15701
P: (724) 463-8378
F: (724) 465-4209
PADEP: 32-00382

1276 Bentleyville Road
Van Voorhis, PA 15366
P: (724) 258-8378
F: (724) 258-8376
PADEP: 63-04247

435 Broad Street
Montoursville, PA 17754
P: (570) 321-9002
F: (570) 321-1957
PADEP: 41-04880

950 West Main Street
Sharpville, PA 16150
P: (724) 463-8378 x 500
F: (724) 465-4209
PADEP: 43-04934

13 December 2021

Moniteau School District
Attn: Jeffrey Campbell
1810 West Sunbury Road
West Sunbury, PA 16061

Work Order: 1120326
Project: Drinking Water Dassa McKinney - Monthly 802
Project Description: Drinking Water

Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
802 Room 617 Sink	1120326-01	Drinking Water	12/02/2021 11:55	12/2/21 14:22	

Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

Definitions

RL Reporting Limit

Certifications


Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.

Environmental Service Laboratories, Inc., Indiana, PA/TNI Certification #32-00382

Approved By

Sierra Grguric
Oil & Gas Field Supervisor/Project Manager



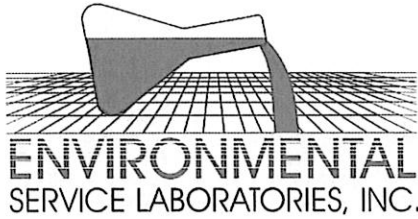

1803 Philadelphia Street
Indiana, PA 15701
P: (724) 463-8378
F: (724) 465-4209
PADEP: 32-00382

1276 Bentleyville Road
Van Voorhis, PA 15366
P: (724) 258-8378
F: (724) 258-8376
PADEP: 63-04247

435 Broad Street
Montoursville, PA 17754
P: (570) 321-9002
F: (570) 321-1957
PADEP: 41-04880

950 West Main Street
Sharpsville, PA 16150
P: (724) 463-8378 x 500
F: (724) 465-4209
PADEP: 43-04934

Moniteau School District
1810 West Sunbury Road
West Sunbury, PA 16061

Reported: 12/13/2021 10:02

Lab Sample ID#: 1120326-01
Sample Type: Drinking Water
Sample Source: Grab
Sampler: Paul Somogyi
Client Sample ID: 802 Room 617 Sink

Sample Date: 12/02/2021 11:55
Receipt Date: 12/02/2021 14:22

Analyte	Sample Result	Units	Data Qualifier	RL	Analyst/ Certification	Prep Date/Time	Analysis Date/Time
Field Analysis	Analytical Method: SM4500-Cl G-11				Prep Method: No Prep - Field		
Chlorine, Free	0.890	mg/L		0.200	PS	12/02/21 11:55	12/02/21 11:55
Microbiology	Analytical Method: SM9223 B-04				Prep Method: No Prep - Micro		
Total Coliform	Absent	per 100 mL		1	VSJ	12/02/21 14:45	12/03/21 14:57
E. Coli	Absent	per 100 mL		1	VSJ	12/02/21 14:45	12/03/21 14:57

This sample MEETS current EPA and DEP bacteriological standards of no detectable coliform bacteria per 100 mL sample.

ENVIRONMENTAL SERVICE LABORATORIES, INC.

HEADQUARTER
1803 Philadelphia St.
Indiana, PA 15701
(724) 463-TEST
FAX: (724) 465-4209

SOUTHERN DIVISION
1276 Bentleyville Road
Van Voorhis, PA 15366
(724) 258-TEST
FAX: (724) 258-8376



1120326

NORTHWEST DIVISION
950 Main Street
Sharpsville, PA 16
(724) 463-TEST
FAX: (724) 465-4209

FOR INTERNAL LABORATORY USE ONLY

SAMPLE REQUEST & CHAIN OF CUSTODY

3E 1 OF 1

Sample Identification	ESL#	Sample Type		Matrix	# of Bottles	Container Type Preservative	Analysis Requested
		Date	Time				
801-KITCHEN SINK 802 ROOM 617 SINK	1120326 07	12-22-11	1155	DW	1	STERILE PLASTIC NA THIO	TC / EC Free Chlorine .89 mg/L

Rotation:

- 801: Jan, Mar, May, Jul, Sep, Nov
- 802: Feb, Apr, Jun, Aug, Oct, Dec

THE UNDERSIGNED PURCHASER HEREBY AGREES TO PAY SERVICE CHARGES ON ACCOUNTS OVER 31 DAYS OLD.

1. THESE SERVICE CHARGES WILL ACCRUE AT THE RATE OF 1 1/2% PER MONTH (18% PER ANNUM OR THE MAXIMUM ALLOWED BY LAW.)
2. THE UNDERSIGNED PURCHASER AGREES TO PAY, IN THE EVENT HIS ACCOUNT BECOMES DELINQUENT AND IS TURNED OVER TO ANY ATTORNEY FOR COLLECTION, REASONABLE ATTORNEY'S FEES PLUS ALL COURT AND ATTENDANT COLLECTION COSTS.

Notes/Special Instructions:

Drinking Water Dassa McKinney - Monthly

Sampled By: (Signature)	Date/ Time	Received By: (Signature)	Date/ Time
	12-22-11 1155		12-22-11 1422
Relinquished By: (Signature)	Date/ Time	Received By: (Signature)	Date/ Time
	12-22-11 1416		
Relinquished By: (Signature)	Date/ Time	Received By: (Signature)	Date/ Time
Correct Preservations Y / N / NA	Correct Containers Y / N / NA	Receipt Temperature	7.51 (C)

Company/Name: **MONTEAU SCHOOL DISTRICT**
 Address: **391 HOOKER ROAD
WEST SUNBURY, PA 16061**
 Contact Person: **JEFFREY CAMPBELL**
 Phone Number: **724-406-4426**
 Cell Phone: **jcampbell@monteateau.org**
 Email Address: **jcampbell@monteateau.org**
 Billing Address:
 PWSID: **5100316**

E-Government Application for Drinking Water Program

SAFE DRINKING WATER ACT
VIEW/EDIT RECORDS

5100316: DASSA MCKINNEY ELEM SCHOOL

SDWA1

PWSID	Contam ID	Contam	Analysis Method	Result	Analysis Date	Location ID 1	Location ID 2	Sample Date	Sample Type	Sample Time	Lab ID	Sample ID	Record ID
5100316	1013	FREE CHLORINE	301	0.87	120921	801		120921	D	1205	32382	1120976-01	BROWNKA_90
5100316	1013	FREE CHLORINE	301	0.89	120221	802		120221	D	1155	32382	1120326-01	BROWNKA_88
5100316	3100	TOTAL COLIFORM PRESENCE	331	0.0	120321	802		120221	D	1155	32382	1120326-01	BROWNKA_89



1803 Philadelphia Street
Indiana, PA 15701
P: (724) 463-8378
F: (724) 465-4209
PADEP: 32-00382

1276 Bentleyville Road
Van Voorhis, PA 15366
P: (724) 258-8378
F: (724) 258-8376
PADEP: 63-04247

435 Broad Street
Montoursville, PA 17754
P: (570) 321-9002
F: (570) 321-1957
PADEP: 41-04880

950 West Main Street
Sharpville, PA 16150
P: (724) 463-8378 x 500
F: (724) 465-4209
PADEP: 43-04934

13 December 2021

Moniteau School District
Attn: Jeffrey Campbell
1810 West Sunbury Road
West Sunbury, PA 16061

Work Order: 1120976
Project: Drinking Water Dassa McKinney - Weekly
Project Description: Drinking Water

Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
801 Kitchen Sink	1120976-01	Drinking Water	12/09/2021 12:05	12/9/21 14:27	

Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

Definitions

RL Reporting Limit

Certifications

Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.

Approved By

Sierra Grguric
Oil & Gas Field Supervisor/Project Manager



1803 Philadelphia Street
Indiana, PA 15701
P: (724) 463-8378
F: (724) 465-4209
PADEP: 32-00382

1276 Bentleyville Road
Van Voorhis, PA 15366
P: (724) 258-8378
F: (724) 258-8376
PADEP: 63-04247

435 Broad Street
Montoursville, PA 17754
P: (570) 321-9002
F: (570) 321-1957
PADEP: 41-04880

950 West Main Street
Sharpsville, PA 16150
P: (724) 463-8378 x 500
F: (724) 465-4209
PADEP: 43-04934

Moniteau School District
1810 West Sunbury Road
West Sunbury, PA 16061

Reported: 12/13/2021 09:55

Lab Sample ID#: 1120976-01
Sample Type: Drinking Water
Sample Source: Grab
Sampler: Paul Somogyi
Client Sample ID: 801 Kitchen Sink

Sample Date: 12/09/2021 12:05
Receipt Date: 12/09/2021 14:27

Analyte	Sample Result	Units	Data Qualifier	RL	Analyst/ Certification	Prep Date/Time	Analysis Date/Time
Field Analysis	Analytical Method: SM4500-Cl G-11			Prep Method: No Prep - Field			
Chlorine, Free	0.870	mg/L		0.200	PS	12/09/21 12:05	12/09/21 12:05

ENVIRONMENTAL SERVICE LABORATORIES, INC.

HEADQUARTER
 1803 Philadelphia St.
 Indiana, PA 15701
 (724) 463-TEST
 FAX: (724) 465-4209

SOUTHERN DIVISION
 1276 Benetleyville Road
 Van Voorhis, PA 15366
 (724) 258-TEST
 FAX: (724) 258-8376

NORTHWEST DIVISION
 950 Main Street
 Sharpville, PA 16
 (724) 463-TEST
 FAX: (724) 465-4209

SAMPLE REQUEST & CHAIN OF CUSTODY

RE 1 OF 1

FOR INTERNAL LABORATORY USE ONLY

Sample Identification	ESL#	Sample Type		Matrix	# of Bottles	Container Type	Analysis Requested
		Grab	Time				
Distribution: 801	1120976		1205	DW	Field	Field	Free Chlorine 0.87 mg/L
<p>ROTATION</p> <p>Wk 1 - 801 Kitchen Sink</p> <p>Wk 2 - 802 Room 617 Sink</p> <p>Wk 3 - 803 Room 606 Sink</p> <p>Wk 4 - 804 Room 408 Sink</p> <p>Wk 5 - 802 Room 617 Sink</p>							

THE UNDERSIGNED PURCHASER HEREBY AGREES TO PAY SERVICE CHARGES ON ACCOUNTS OVER 31 DAYS OLD.

1. THESE SERVICE CHARGES WILL ACCRUE AT THE RATE OF 1.12% PER MONTH (18% PER ANNUM OR THE MAXIMUM ALLOWED BY LAW.)
2. THE UNDERSIGNED PURCHASER AGREES TO PAY, IN THE EVENT HIS ACCOUNT BECOMES DELINQUENT AND IS TURNED OVER TO ANY ATTORNEY FOR COLLECTION, REASONABLE ATTORNEY'S FEES PLUS ALL COURT AND ATTENDANT COLLECTION COSTS.

Sampled By: (Signature) *[Signature]* Date/Time 12-9-21 1005
 Relinquished By: (Signature) *[Signature]* Date/Time 12-9-21 1445

Received By: (Signature) *[Signature]* Date/Time 12/9/21 1427
 Received By: (Signature) _____ Date/Time _____
 Received By: (Signature) _____ Date/Time _____

Notes/Special Instructions:
Drinking Water Dassa McKinney - Weekly

Company/Name: **MONITEAU SCHOOL DISTRICT**
 Address: **391 HOOKER ROAD**
WEST SUNBURY, PA 16061
JEFFREY CAMPBELL
 Contact Person: _____
 Phone Number: _____
 Cell Phone: **724-406-4426**
 Email Address: **jcambell@moniteau.org**
 Billing Address: _____
 PWSID: **5100316**

Correct Preservations Y / N / NA Correct Containers Y / N / NA Receipt Temperature _____

5100316: DASSA MCKINNEY ELEM SCHOOL

SDWA1

PWSID	Contam ID	Contam	Analysis Method	Result	Analysis Date	Location ID 1	Location ID 2	Sample Date	Sample Type	Sample Time	Lab ID	Sample ID	Record ID
5100316	1013	FREE CHLORINE	301	0.87	120921	801		120921	D	1205	32382	1120976-01	BROWNKA_90
5100316	1013	FREE CHLORINE	301	0.89	120221	802		120221	D	1155	32382	1120326-01	BROWNKA_88
5100316	3100	TOTAL COLIFORM PRESENCE	331	0.0	120321	802		120221	D	1155	32382	1120326-01	BROWNKA_89

Moniteau School District
Voucher # CF0037 for 2020-2021

Date	Voucher #/Vendor Name	SRC	Debits	Credits	Total
10/21/20	CF0037	CR			
	REMOTE CAPTURE	501010000000 /51-0101-000-00-0000-00-000-0000	176.00		176.00
		Cash Control Account			
	REMOTE CAPTURE-DASSA SALES	00004082 /51-6620-000-000-10-9999-10-999-9999		-69.75	-69.75
		Daily Sales - Non-reimbursable - Prepaid Cash - Dassa			
	REMOTE CAPTURE-JR/SR	00004081 /51-6620-000-000-30-9999-30-999-9999		-106.25	-106.25
		Daily Sales - Non-reimbursable - Prepaid Cash-JR/SR			
		Voucher Total	176.00	-176.00	0.00
		Report Total	176.00	-176.00	0.00



1803 Philadelphia Street
Indiana, PA 15701
P: (724) 463-8378
F: (724) 465-4209
PADEP: 32-00382

1276 Bentleyville Road
Van Voorhis, PA 15366
P: (724) 258-8378
F: (724) 258-8376
PADEP: 63-04247

435 Broad Street
Montoursville, PA 17754
P: (570) 321-9002
F: (570) 321-1957
PADEP: 41-04880

950 West Main Street
Sharpville, PA 16150
P: (724) 463-8378 x 500
F: (724) 465-4209
PADEP: 43-04934

17 December 2021

Moniteau School District
Attn: Jeffrey Campbell
1810 West Sunbury Road
West Sunbury, PA 16061

Work Order: 1121591
Project: Drinking Water Dassa McKinney - Weekly
Project Description: Drinking Water

Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
803 Room 606 Sink	1121591-01	Drinking Water	12/16/2021 11:05	12/16/21 13:30	

Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

Definitions

RL Reporting Limit

Certifications

Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.

Approved By

Sierra Grguric
Oil & Gas Field Supervisor/Project Manager



1803 Philadelphia Street
Indiana, PA 15701
P: (724) 463-8378
F: (724) 465-4209
PADEP: 32-00382

1276 Bentleyville Road
Van Voorhis, PA 15366
P: (724) 258-8378
F: (724) 258-8376
PADEP: 63-04247

435 Broad Street
Montoursville, PA 17754
P: (570) 321-9002
F: (570) 321-1957
PADEP: 41-04880

950 West Main Street
Sharpsville, PA 16150
P: (724) 463-8378 x 500
F: (724) 465-4209
PADEP: 43-04934

Moniteau School District
1810 West Sunbury Road
West Sunbury, PA 16061

Reported: 12/17/2021 14:46

Lab Sample ID#: 1121591-01
Sample Type: Drinking Water
Sample Source: Grab
Sampler: Paul Somogyi
Client Sample ID: 803 Room 606 Sink

Sample Date: 12/16/2021 11:05
Receipt Date: 12/16/2021 13:30

Analyte	Sample Result	Units	Data Qualifier	RL	Analyst/ Certification	Prep Date/Time	Analysis Date/Time
Field Analysis	Analytical Method: SM4500-Cl G-11			Prep Method: No Prep - Field			
Chlorine, Free	0.530	mg/L		0.200	PS	12/16/21 11:05	12/16/21 11:05

5100316: DASSA MCKINNEY ELEM SCHOOL
SDWA1

PWSID	Contam ID	Contam	Analysis Method	Result	Analysis Date	Location ID 1	Location ID 2	Sample Date	Sample Type	Sample Time	Lab ID	Sample ID	Record ID
5100316	1013	FREE CHLORINE	301	0.87	120921	801		120921	D	1205	32382	1120976-01	BROWNKA_90
5100316	1013	FREE CHLORINE	301	0.89	120221	802		120221	D	1155	32382	1120326-01	BROWNKA_88
5100316	3100	TOTAL COLIFORM PRESENCE	331	0.0	120321	802		120221	D	1155	32382	1120326-01	BROWNKA_89
5100316	1013	FREE CHLORINE	301	0.53	121621	803		121621	D	1105	32382	1121591-01	BROWNKA_872

ENVIRONMENTAL SERVICE LABORATORIES, INC.

SAMPLE REQUEST & CHAIN OF CUSTODY

HEADQUARTER 1803 Philadelphia St. Indiana, PA 15701 (724) 463-TEST FAX: (724) 465-4209	SOUTHERN DIVISI 1276 Bentleyville Rr Van Voorhis, PA 15 (724) 258-TEST FAX: (724) 258-83	NORTHWEST DIVISION 950 Main Street Sharpsville, PA 16 (724) 463-TEST FAX: (724) 465-4209
---	---	---

FOR INTERNAL LABORATORY USE ONLY

Sample Identification	ESL#	Sample Type		Matrix	# of Bottles	Container Type	Analysis Requested
		Grab	Time				
Distribution: 803	1121591		1105	DW	Field	Field	Free Chlorine - 83 mg/L
ROTATION Wk 1 - 801 Kitchen Sink Wk 2 - 802 Room 617 Sink Wk 3 - 803 Room 606 Sink Wk 4 - 804 Room 408 Sink Wk 5 - 802 Room 617 Sink							

THE UNDERSIGNED PURCHASER HEREBY AGREES TO PAY SERVICE CHARGES ON ACCOUNTS OVER 31 DAYS OLD.

1. THESE SERVICE CHARGES WILL ACCRUE AT THE RATE OF 1 1/2% PER MONTH (18% PER ANNUM OR THE MAXIMUM ALLOWED BY LAW.)

2. THE UNDERSIGNED PURCHASER AGREES TO PAY, IN THE EVENT HIS ACCOUNT BECOMES DELINQUENT AND IS TURNED OVER TO ANY ATTORNEY FOR COLLECTION, REASONABLE ATTORNEY'S FEES PLUS ALL COURT AND ATTENDANT COLLECTION COSTS.

Drinking Water Dassa McKinney - Weekly

Company/Name: Address: Contact Person: Phone Number: Cell Phone: Email Address: Billing Address: PWSID:	MONITEAU SCHOOL DISTRICT 391 HOOKER ROAD WEST SUNBURY, PA 16061 JEFFREY CAMPBELL 724-406-4426 jcampbell@moniteau.org 5100316
--	--

Sampled By: (Signature) Date/ Time 12-16-21 1105	Received By: (Signature) Date/ Time JPM (60580) 12/16/21 1330	Relinquished By: (Signature) Date/ Time 12-16-21 1305
Relinquished By: (Signature) Date/ Time	Received By: (Signature) Date/ Time	Received By: (Signature) Date/ Time
Correct Preservations Y / N / NA	Correct Containers Y / N / NA	Receipt Temperature



1803 Philadelphia Street
Indiana, PA 15701
P: (724) 463-8378
F: (724) 465-4209
PADEP: 32-00382

1276 Bentleyville Road
Van Voorhis, PA 15366
P: (724) 258-8378
F: (724) 258-8376
PADEP: 63-04247

435 Broad Street
Montoursville, PA 17754
P: (570) 321-9002
F: (570) 321-1957
PADEP: 41-04880

950 West Main Street
Sharpsville, PA 16150
P: (724) 463-8378 x 500
F: (724) 465-4209
PADEP: 43-04934

22 December 2021

Moniteau School District
Attn: Jeffrey Campbell
1810 West Sunbury Road
West Sunbury, PA 16061

Work Order: 1121861
Project: Drinking Water Dassa McKinney - Weekly
Project Description: Drinking Water

Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
804 Room 408 Sink	1121861-01	Drinking Water	12/20/2021 08:37	12/20/21 15:11	

Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

Definitions

RL Reporting Limit

Certifications

Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.

Approved By

Carrie Sutton-White
Project Manager



1803 Philadelphia Street
Indiana, PA 15701
P: (724) 463-8378
F: (724) 465-4209
PADEP: 32-00382

1276 Bentleyville Road
Van Voorhis, PA 15366
P: (724) 258-8378
F: (724) 258-8376
PADEP: 63-04247

435 Broad Street
Montoursville, PA 17754
P: (570) 321-9002
F: (570) 321-1957
PADEP: 41-04880

950 West Main Street
Sharpsville, PA 16150
P: (724) 463-8378 x 500
F: (724) 465-4209
PADEP: 43-04934

Moniteau School District
1810 West Sunbury Road
West Sunbury, PA 16061

Reported: 12/22/2021 14:54

Lab Sample ID#: 1121861-01
Sample Type: Drinking Water
Sample Source: Grab
Sampler: Paul Somogyi
Client Sample ID: 804 Room 408 Sink

Sample Date: 12/20/2021 08:37
Receipt Date: 12/20/2021 15:11

Analyte	Sample Result	Units	Data Qualifier	RL	Analyst/ Certification	Prep Date/Time	Analysis Date/Time
Field Analysis	Analytical Method: SM4500-Cl G-11			Prep Method: No Prep - Field			
Chlorine, Free	0.610	mg/L		0.200	PS	12/20/21 08:37	12/20/21 08:37

5100316: DASSA MCKINNEY ELEM SCHOOL

SDWA1

PWSID	Contam ID	Contam	Analysis Method	Result	Analysis Date	Location ID 1	Location ID 2	Sample Date	Sample Type	Sample Time	Lab ID	Sample ID	Record ID
5100316	1013	FREE CHLORINE	301	0.87	120921	801		120921	D	1205	32382	1120976-01	BROWNKA_90
5100316	1013	FREE CHLORINE	301	0.89	120221	802		120221	D	1155	32382	1120326-01	BROWNKA_88
5100316	3100	TOTAL COLIFORM PRESENCE	331	0.0	120321	802		120221	D	1155	32382	1120326-01	BROWNKA_89
5100316	1013	FREE CHLORINE	301	0.53	121621	803		121621	D	1105	32382	1121591-01	BROWNKA_872
5100316	1013	FREE CHLORINE	301	0.61	122021	804		122021	D	0837	32382	1121861-01	BROWNKA_1034

ENVIRONMENTAL SERVICE LABORATORIES, INC.

HEADQUARTER
1803 Philadelphia St.
Indiana, PA 15701
(724) 463-TEST
FAX: (724) 465-4209

SOUTHERN DIVISIC
1276 Benlleyville Ro
Van Voorhis, PA 153
(724) 258-TEST
FAX: (724) 258-837



1121861

NORTHWEST DIVISION
950 Main Street
Sharpsville, PA 16
(724) 463-TEST
FAX: (724) 465-4209

SAMPLE REQUEST & CHAIN OF CUSTODY

3E 1 OF 1

Sample Identification	ESL#	Sample Type		Matrix	# of Bottles	Container Type Preservative	Analysis Requested
		Date	Time				
Distribution: 804	1121861	12-20-04	0837	DW	Field	Field	Free Chlorine 0.1 mg/L
<p>ROTATION</p> <p>Wk 1 - 801 Kitchen Sink</p> <p>Wk 2 - 802 Room 617 Sink</p> <p>Wk 3 - 803 Room 606 Sink</p> <p>Wk 4 - 804 Room 408 Sink</p> <p>Wk 5 - 802 Room 617 Sink</p>							

THE UNDERSIGNED PURCHASER HEREBY AGREES TO PAY SERVICE CHARGES ON ACCOUNTS OVER 31 DAYS OLD.

1. THESE SERVICE CHARGES WILL ACCRUE AT THE RATE OF 1 1/2% PER MONTH (18% PER ANNUM OR THE MAXIMUM ALLOWED BY LAW.)

2. THE UNDERSIGNED PURCHASER AGREES TO PAY, IN THE EVENT HIS ACCOUNT BECOMES DELINQUENT AND IS TURNED OVER TO ANY ATTORNEY FOR COLLECTION, REASONABLE ATTORNEY'S FEES PLUS ALL COURT AND ATTENDANT COLLECTION COSTS.

Notes/Special Instructions:
Drinking Water Dassa McKinney - Weekly

Company/Name: **MONITEAU SCHOOL DISTRICT**

Address: **391 HOOKER ROAD
WEST SUNBURY, PA 16061
JEFFREY CAMPBELL**

Contact Person: **724-406-4426
jcampbell@moniteau.org**

Phone Number: **5100316**

Cell Phone:

Email Address:

Billing Address:

PWSID:

Sampled By: (Signature) *[Signature]* Date/ Time **12-20-04 0837** (003882)

Relinquished By: (Signature) *[Signature]* Date/ Time **12-20-04 1508**

Received By: (Signature) *[Signature]* Date/ Time **12/20/21 1511**

Received By: (Signature) Date/ Time

Received By: (Signature) Date/ Time

Received By: (Signature) Date/ Time

Correct Preservations Y / N / NA Correct Containers Y / N / NA Receipt Temperature



1803 Philadelphia Street
Indiana, PA 15701
P: (724) 463-8378
F: (724) 465-4209
PADEP: 32-00382

1276 Bentleyville Road
Van Voorhis, PA 15366
P: (724) 258-8378
F: (724) 258-8376
PADEP: 63-04247

435 Broad Street
Montoursville, PA 17754
P: (570) 321-9002
F: (570) 321-1957
PADEP: 41-04880

950 West Main Street
Sharpsville, PA 16150
P: (724) 463-8378 x 500
F: (724) 465-4209
PADEP: 43-04934

28 December 2021

Moniteau School District
Attn: Jeffrey Campbell
1810 West Sunbury Road
West Sunbury, PA 16061

Work Order: 1122275
Project: Drinking Water Dassa McKinney - Weekly
Project Description: Drinking Water

Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
802 Room 617 Sink	1122275-01	Drinking Water	12/27/2021 08:35	12/27/21 15:30	

Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

Definitions

RL Reporting Limit

Certifications

Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.

Approved By

Carrie G. Sutton-White

Carrie Sutton-White
Project Manager



1803 Philadelphia Street
 Indiana, PA 15701
 P: (724) 463-8378
 F: (724) 465-4209
 PADEP: 32-00382

1276 Bentleyville Road
 Van Voorhis, PA 15366
 P: (724) 258-8378
 F: (724) 258-8376
 PADEP: 63-04247

435 Broad Street
 Montoursville, PA 17754
 P: (570) 321-9002
 F: (570) 321-1957
 PADEP: 41-04880

950 West Main Street
 Sharpsville, PA 16150
 P: (724) 463-8378 x 500
 F: (724) 465-4209
 PADEP: 43-04934

Moniteau School District
 1810 West Sunbury Road
 West Sunbury, PA 16061

Reported: 12/28/2021 18:31

Lab Sample ID#: 1122275-01
Sample Type: Drinking Water
Sample Source: Grab
Sampler: Paul Somogyi
Client Sample ID: 802 Room 617 Sink

Sample Date: 12/27/2021 08:35
Receipt Date: 12/27/2021 15:30

Analyte	Sample Result	Units	Data Qualifier	RL	Analyst/ Certification	Prep Date/Time	Analysis Date/Time
Field Analysis	Analytical Method: SM4500-Cl G-11		Prep Method: No Prep - Field				
Chlorine, Free	0.570	mg/L		0.200	PS	12/27/21 08:35	12/27/21 08:35

ENVIRONMENTAL SERVICE LABORATORIES, INC.

HEADQUARTER
1803 Philadelphia St.
Indiana, PA 15701
(724) 463-TEST
FAX: (724) 465-4209

SOUTHERN DIVISION
1276 Bentleyville Road
Van Voorhis, PA 15366
(724) 258-TEST
FAX: (724) 258-8376

FOR INTERNAL LABORATORY USE ONLY

FAX: (570) 321-1957



WEST DIVISION
in Street
Jillie, PA 16
(724) 463-TEST
FAX: (724) 465-4209

SAMPLE REQUIRED - 1/1N OF CUSTODY

3E 1 OF 1

Sample Identification	ESL#	Sample Type		Matrix	# of Bottles	Container Type Preservative	Analysis Requested
		Grab	Time				
Distribution: <u>SU</u>	<u>1122275</u>	Date: <u>12-27-21</u>	Time: <u>0835</u>	DW	Field	Field	Free Chlorine <u>.57</u> mg/L
<p>ROTATION</p> <p>Wk 1 - 801 Kitchen Sink</p> <p>Wk 2 - 802 Room 617 Sink</p> <p>Wk 3 - 803 Room 606 Sink</p> <p>Wk 4 - 804 Room 408 Sink</p> <p>Wk 5 - 802 Room 617 Sink</p>							
<p>THE UNDERSIGNED PURCHASER HEREBY AGREES TO PAY SERVICE CHARGES ON ACCOUNTS OVER 31 DAYS OLD.</p> <p>1. THESE SERVICE CHARGES WILL ACCRUE AT THE RATE OF 1.12% PER MONTH (18% PER ANNUM OR THE MAXIMUM ALLOWED BY LAW).</p> <p>2. THE UNDERSIGNED PURCHASER AGREES TO PAY, IN THE EVENT HIS ACCOUNT BECOMES DELINQUENT AND IS TURNED OVER TO ANY ATTORNEY FOR COLLECTION, REASONABLE ATTORNEY'S FEES PLUS ALL COURT AND ATTENDANT COLLECTION COSTS.</p>							
<p>Notes/Special Instructions: Drinking Water Dassa McKinney - Weekly</p>							
<p>Sampled By: (Signature) <u>[Signature]</u> Date/ Time <u>12-27-21 0835</u></p>				<p>Company/Name: MONITEAU SCHOOL DISTRICT</p>			
<p>Relinquished By: (Signature) <u>[Signature]</u> Date/ Time <u>12-27-21 1500</u></p>				<p>Address: 391 HOOKER ROAD</p>			
<p>Relinquished By: (Signature) _____ Date/ Time _____</p>				<p>Contact Person: JEFFREY CAMPBELL</p>			
<p>Relinquished By: (Signature) _____ Date/ Time _____</p>				<p>Phone Number: 724-406-4426</p>			
<p>Relinquished By: (Signature) _____ Date/ Time _____</p>				<p>Cell Phone: jcampbell@moniteau.org</p>			
<p>Correct Preservations Y / N (NA)</p>				<p>Billing Address: WEST SUNBURY, PA 16061</p>			
<p>Correct Containers Y / N (NA)</p>				<p>PWSID: 5100316</p>			
<p>Receipt Temperature _____</p>				<p>Received By: (Signature) <u>[Signature]</u> Date/ Time <u>12-27-21 1530</u></p>			

E-Government Application for Drinking Water Program

**SAFE DRINKING WATER ACT
VIEW/EDIT RECORDS**

5100316: DASSA MCKINNEY ELEM SCHOOL

SDWA1


PWSID	Contam ID	Contam	Analysis Method	Result	Analysis Date	Location ID 1	Location ID 2	Sample Date	Sample Type	Sample Time	Lab ID	Sample ID	Record ID
5100316	1013	FREE CHLORINE	301	0.87	120921	801		120921	D	1205	32382	1120976-01	BROWNKA_90
5100316	1013	FREE CHLORINE	301	0.89	120221	802		120221	D	1155	32382	1120326-01	BROWNKA_88
5100316	1013	FREE CHLORINE	301	0.57	122721	802		122721	D	0835	32382	1122275-01	BROWNKA_1181
5100316	3100	TOTAL COLIFORM PRESENCE	331	0.0	120321	802		120221	D	1155	32382	1120326-01	BROWNKA_89
5100316	1013	FREE CHLORINE	301	0.53	121621	803		121621	D	1105	32382	1121591-01	BROWNKA_872
5100316	1013	FREE CHLORINE	301	0.61	122021	804		122021	D	0837	32382	1121861-01	BROWNKA_1034

**Moniteau School District
Maintenance Department
Moniteau High School
Water Treatment Facility
Monthly Operations Report
December 2021**

MONTH		MONTEAU HIGH SCHOOL WATER TREATMENT PLANT											JEFF CAMPBELL	
DAY	TEMP	LEVEL	METER READING	CL2 FREE	CL2 TOTAL	PH	IRON	MAG.	HARDNESS	OPERATOR	TIME			
1	Wed	46.0	5,426,157	0.73	0.75	7.1	0.02	0	0.99	Jeff C	7:15 AM			
2	Thurs	48.0	5,427,928	0.80	0.80	7.2	0.00	0	1.29	Jeff C	8:30 AM			
3	Fri	51.9	5,442,300	0.68	0.73	7.2	0.00	0	1.30	Jeff C	10:00 AM			
4	SAT													
5	SUN													
6	Mon	50.2	5,442,392	0.70	0.79	7.3	0.01	0	2.01	Jeff C	10:00 AM			
7	Tues	52.2	5,456,808	0.36	0.42	7.1	0.03	0	2.57	Jeff C	11:00 AM			
8	wed	50.3	5,456,808	0.60	0.69	7.1	0.02	0	0.97	Jeff C	11:00 AM			
9	Thurs	46.6	5,456,808	0.60	0.67	7.1	0.02	0	1.72	Jeff C	1:00 PM			
10	Fri	52.0	5,471,1722	0.53	0.62	7.1	0.02	0	1.70	Jeff C	10:00 AM			
11	SAT													
12	SUN													
13	Mon	51.9	5,471,722	0.49	0.58	7.1	0.03	0	1.06	Jeff C	2:00 PM			
14	Tues	49.9	5,471,655	0.47	0.58	7.1	0.02	0	1.08	Jeff C	8:30 AM			
15	wed	55.5	5,486,224	0.56	0.66	7.1	0.02	0	1.12	Jeff R	11:00 AM			
16	Thurs	54.0	5,486,224	0.63	0.73	7.2	0.00	0	1.16	Jeff R	11:30 AM			
17	Fri	55.1	5,486,224	0.69	0.76	7.1	0.00	0	0.95	Jeff R	11:30 AM			
18	SAT													
19	SUN													
20	Mon	50.0	5,500,019	0.76	0.84	7.1	0.02	0	1.46	Jeff C	9:00 AM			
21	Tues	50.4	5,500,019	0.76	0.85	7.1	0.01	0	1.41	Jeff C	10:00 AM			
22	wed	52.0	5,506,677	0.77	0.84	7.1	0.00	0	1.21	Jeff C	4:00 PM			
23	Thurs	51.7	5,506,677	0.76	0.83	7.1	0.00	0	1.20	Jeff C	10:30 AM			
24	Fri	50.5	5,516,621	0.74	0.81	7.1	0.00	0	1.18	Jeff C	5:30 PM			
25	SAT													
26	SUN													
27	Mon	50.2	5,516,621	0.73	0.80	7.1	0.00	0	1.16	Jeff C	7:00 AM			
28	Tues	47.4	5,516,621	0.74	0.79	7.1	0.00	0	1.15	Jeff C	8:00 AM			
29	wed	46.8	5,516,621	0.74	0.80	7.1	0.00	0	1.15	Jeff C	9:00 AM			
30	Thurs	46.8	5,516,621	0.74	0.81	7.1	0.00	0	1.15	Jeff C	8:00 AM			
31	Fri	46.9	5,516,621	0.74	0.80	7.1	0.00	0	1.15	Jeff C	9:00 AM			

Meter Reading on 11/30/21 - 5,426,157

█ = Sewage Samples █ = Water Samples

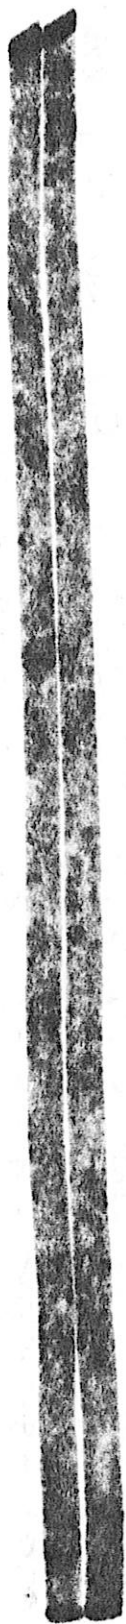



1803 Philadelphia Street
 Indiana, PA 15701
 P: (724) 463-8378
 F: (724) 465-4209
 PADEP: 32-00382

1276 Bentleyville Road
 Van Voorhis, PA 15366
 P: (724) 258-8378
 F: (724) 258-8376
 PADEP: 63-04247

435 Broad Street
 Montoursville, PA 17754
 P: (570) 321-9002
 F: (570) 321-1957
 PADEP: 41-04880

950 West Main Street
 Sharpsville, PA 16150
 P: (724) 463-8378 x 500
 F: (724) 465-4209
 PADEP: 43-04934

13 December 2021

Moniteau School District
 Attn: Jeffrey Campbell
 1810 West Sunbury Road
 West Sunbury, PA 16061

Work Order: 1120973
Project: Drinking Water Moniteau Jr/Sr - Weekly
Project Description: Drinking Water

Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
704 Kitchen Main Sink	1120973-01	Drinking Water	12/09/2021 12:25	12/9/21 14:27	

Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

Definitions

RL Reporting Limit

Certifications

Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.

Approved By

Sierra Grguric
 Oil & Gas Field Supervisor/Project Manager



1803 Philadelphia Street
Indiana, PA 15701
P: (724) 463-8378
F: (724) 465-4209
PADEP: 32-00382

1276 Bentleyville Road
Van Voorhis, PA 15366
P: (724) 258-8378
F: (724) 258-8376
PADEP: 63-04247

435 Broad Street
Montoursville, PA 17754
P: (570) 321-9002
F: (570) 321-1957
PADEP: 41-04880

950 West Main Street
Sharpsville, PA 16150
P: (724) 463-8378 x 500
F: (724) 465-4209
PADEP: 43-04934

Moniteau School District
1810 West Sunbury Road
West Sunbury, PA 16061

Reported: 12/13/2021 09:56

Lab Sample ID#: 1120973-01
Sample Type: Drinking Water
Sample Source: Grab
Sampler: Paul Somogyi
Client Sample ID: 704 Kitchen Main Sink

Sample Date: 12/09/2021 12:25
Receipt Date: 12/09/2021 14:27

Analyte	Sample Result	Units	Data Qualifier	RL	Analyst/ Certification	Prep Date/Time	Analysis Date/Time
Field Analysis	Analytical Method: SM4500-Cl G-11				Prep Method: No Prep - Field		
Chlorine, Free	0.610	mg/L		0.200	PS	12/09/21 12:25	12/09/21 12:25

ENVIRONMENTAL SERVICE LABORATORIES, INC.

HEADQUARTER
 1803 Philadelphia St.
 Indiana, PA 15701
 (724) 463-TEST
 FAX: (724) 465-4209



NORTHWEST DIVISION
 950 Main Street
 Sharpshville, PA 16
 (724) 463-TEST
 FAX: (724) 465-4209

SAMPLE REQUEST & CHAIN OF CUSTODY

BE 1 OF 1

Sample Identification	ESL#	Sample Type		Matrix	# of Bottles	Container Type	Analysis Requested
		Grab	Time				
Distribution: 704	1120973	12-9-21	1225	DW	Field	Field	Free Chlorine <u>0.1</u> mg/L
<p>ROTATION</p> <p>Wk 1 - 704 Kitchen Sink</p> <p>Wk 2 - 802 Room 204 Sink</p> <p>Wk 3 - 803 Admin Sink</p> <p>Wk 4 - 804 400 Hall RR Sink</p> <p>Wk 5 - 804 400 Hall RR Sink</p>							
<p>Notes/Special Instructions:</p> <p><i>Drinking Water Moniteau Jr/Sr - Weekly</i></p>							
<p>THE UNDERSIGNED PURCHASER HEREBY AGREES TO PAY SERVICE CHARGES ON ACCOUNTS OVER 31 DAYS OLD.</p>		<p>1. THESE SERVICE CHARGES WILL ACCRUE AT THE RATE OF 1.12% PER MONTH (18% PER ANNUM OR THE MAXIMUM ALLOWED BY LAW).</p> <p>2. THE UNDERSIGNED PURCHASER AGREES TO PAY, IN THE EVENT HIS ACCOUNT BECOMES DELINQUENT AND IS TURNED OVER TO ANY ATTORNEY FOR COLLECTION, REASONABLE ATTORNEY'S FEES PLUS ALL COURT AND ATTENDANT COLLECTION COSTS.</p>					
<p>Sampled By: (Signature) <i>[Signature]</i></p> <p>Date/Time: 12-9-21 1225</p>		<p>Company/Name: MONITEAU SCHOOL DISTRICT</p> <p>Address: 391 HOOKER ROAD WEST SUNBURY, PA 16061</p> <p>Contact Person: JEFFREY CAMPBELL</p> <p>Phone Number: 724-406-4426</p> <p>Cell Phone: icampbell@moniteau.org</p> <p>Billing Address: 5100324</p> <p>PWSID: 5100324</p>					
<p>Relinquished By: (Signature) <i>[Signature]</i></p> <p>Date/Time: 12-9-21 1225</p>		<p>Received By: (Signature) <i>[Signature]</i></p> <p>Date/Time: 12/9/21 1427</p>					
<p>Relinquished By: (Signature) <i>[Signature]</i></p> <p>Date/Time: 12-9-21 1425</p>		<p>Received By: (Signature) <i>[Signature]</i></p> <p>Date/Time: 12/9/21 1425</p>					
<p>Relinquished By: (Signature) <i>[Signature]</i></p> <p>Date/Time: 12-9-21 1425</p>		<p>Received By: (Signature) <i>[Signature]</i></p> <p>Date/Time: 12/9/21 1425</p>					
<p>Correct Preservations Y / N / NA</p>		<p>Correct Containers Y / N / NA</p>		<p>Receipt Temperature</p>			

E-Government Application for Drinking Water Program

SAFE DRINKING WATER ACT
VIEW/EDIT RECORDS

5100324: MONITEAU JR/SR HIGH SCHOOL

SDWA1

PWSID	Contam ID	Contam	Analysis Method	Result	Analysis Date	Location ID 1	Location ID 2	Sample Date	Sample Type	Sample Time	Lab ID	Sample ID	Record ID
5100324	1013	FREE CHLORINE	301	0.61	120921	704		120921	D	1225	32382	1120973-01	BROWNKA_95
5100324	1013	FREE CHLORINE	301	0.74	120221	802		120221	D	1215	32382	1120325-01	BROWNKA_93
5100324	3100	TOTAL COLIFORM PRESENCE	331	0.0	120321	802		120221	D	1215	32382	1120325-01	BROWNKA_94



1803 Philadelphia Street
Indiana, PA 15701
P: (724) 463-8378
F: (724) 465-4209
PADEP: 32-00382

1276 Bentleyville Road
Van Voorhis, PA 15366
P: (724) 258-8378
F: (724) 258-8376
PADEP: 63-04247

435 Broad Street
Montoursville, PA 17754
P: (570) 321-9002
F: (570) 321-1957
PADEP: 41-04880

950 West Main Street
Sharpville, PA 16150
P: (724) 463-8378 x 500
F: (724) 465-4209
PADEP: 43-04934

13 December 2021

Moniteau School District
Attn: Jeffrey Campbell
1810 West Sunbury Road
West Sunbury, PA 16061

Work Order: 1120326
Project: Drinking Water Dassa McKinney - Monthly 802
Project Description: Drinking Water

Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
802 Room 617 Sink	1120326-01	Drinking Water	12/02/2021 11:55	12/2/21 14:22	

Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

Definitions

RL Reporting Limit

Certifications

Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.
Environmental Service Laboratories, Inc., Indiana, PA/TNI Certification #32-00382

Approved By

Sierra Grguric
Oil & Gas Field Supervisor/Project Manager





1803 Philadelphia Street
Indiana, PA 15701
P: (724) 463-8378
F: (724) 465-4209
PADEP: 32-00382

1276 Bentleyville Road
Van Voorhis, PA 15366
P: (724) 258-8378
F: (724) 258-8376
PADEP: 63-04247

435 Broad Street
Montoursville, PA 17754
P: (570) 321-9002
F: (570) 321-1957
PADEP: 41-04880

950 West Main Street
Sharpsville, PA 16150
P: (724) 463-8378 x 500
F: (724) 465-4209
PADEP: 43-04934

Moniteau School District
1810 West Sunbury Road
West Sunbury, PA 16061

Reported: 12/13/2021 10:02

Lab Sample ID#: 1120326-01
Sample Type: Drinking Water
Sample Source: Grab
Sampler: Paul Somogyi
Client Sample ID: 802 Room 617 Sink

Sample Date: 12/02/2021 11:55
Receipt Date: 12/02/2021 14:22

Analyte	Sample Result	Units	Data Qualifier	RL	Analyst/ Certification	Prep Date/Time	Analysis Date/Time
Field Analysis	Analytical Method: SM4500-Cl G-11				Prep Method: No Prep - Field		
Chlorine, Free	0.890	mg/L		0.200	PS	12/02/21 11:55	12/02/21 11:55
Microbiology	Analytical Method: SM9223 B-04				Prep Method: No Prep - Micro		
Total Coliform	Absent	per 100 mL		1	VSJ	12/02/21 14:45	12/03/21 14:57
E. Coli	Absent	per 100 mL		1	VSJ	12/02/21 14:45	12/03/21 14:57

This sample MEETS current EPA and DEP bacteriological standards of no detectable coliform bacteria per 100 mL sample.

ENVIRONMENTAL SERVICE LABORATORIES, INC.

HEADQUARTER
1803 Philadelphia St.
Indiana, PA 15701
(724) 463-TEST
FAX: (724) 465-4209

SOUTHERN DIVISION
1276 Bentleyville Road
Van Voorhis, PA 15386
(724) 258-TEST
FAX: (724) 258-8376



1120326

NORTHWEST DIVISION
950 Main Street
Sharpsville, PA 16
(724) 463-TEST
FAX: (724) 465-4209

FOR INTERNAL LABORATORY USE ONLY

SAMPLE REQUEST & CHAIN OF CUSTODY

DE 1 OF 1

Sample Identification	ESL#	Matrix	# of Bottles	Container Type Preservative	Analysis Requested
	1120326				
804-KITCHEN'SINK	Date	Sample Type			
802 ROOM 617 SINK	12-22-11	Grab			
	Time				
	1155				

Rotation:
801: Jan, Mar, May, Jul, Sep,
Nov
802: Feb, Apr, Jun, Aug, Oct,
Dec

Notes/Special Instructions:
Drinking Water Dassa McKinney - Monthly

1. THESE SERVICE CHARGES WILL ACCRUE AT THE RATE OF 1 1/2% PER MONTH (18% PER ANNUM OR THE MAXIMUM ALLOWED BY LAW.)
2. THE UNDERSIGNED PURCHASER AGREES TO PAY, IN THE EVENT HIS ACCOUNT BECOMES DELINQUENT AND IS TURNED OVER TO ANY ATTORNEY FOR COLLECTION, REASONABLE ATTORNEY'S FEES PLUS ALL COURT AND ATTENDANT COLLECTION COSTS.

Company/Name: **MONITEAU SCHOOL DISTRICT**
Address: **391 HOOKER ROAD
WEST SUNBURY, PA 16061
JEFFREY CAMPBELL**
Contact Person:
Phone Number:
Cell Phone: **724-406-4426**
Email Address: **jcambell@moniteau.org**
Billing Address:
PWSID: **5100316**

Received By: (Signature) *[Signature]* Date/ Time **12-22-11 1422**
Received By: (Signature) *[Signature]* Date/ Time
Received By: (Signature) *[Signature]* Date/ Time
Correct Preservations Y / N / NA
Correct Containers Y / N / NA
Receipt Temperature **7.51 (C)**

5100316: DASSA MCKINNEY ELEM SCHOOL

SDWA1

PWSID	Contam ID	Contam	Analysis Method	Result	Analysis Date	Location ID 1	Location ID 2	Sample Date	Sample Type	Sample Time	Lab ID	Sample ID	Record ID
5100316	1013	FREE CHLORINE	301	0.87	120921	801		120921	D	1205	32382	1120976-01	BROWNKA_90
5100316	1013	FREE CHLORINE	301	0.89	120221	802		120221	D	1155	32382	1120326-01	BROWNKA_88
5100316	3100	TOTAL COLIFORM PRESENCE	331	0.0	120321	802		120221	D	1155	32382	1120326-01	BROWNKA_89



1803 Philadelphia Street
 Indiana, PA 15701
 P: (724) 463-8378
 F: (724) 465-4209
 PADEP: 32-00382

1276 Bentleyville Road
 Van Voorhis, PA 15366
 P: (724) 258-8378
 F: (724) 258-8376
 PADEP: 63-04247

435 Broad Street
 Montoursville, PA 17754
 P: (570) 321-9002
 F: (570) 321-1957
 PADEP: 41-04880

950 West Main Street
 Sharpsville, PA 16150
 P: (724) 463-8378 x 500
 F: (724) 465-4209
 PADEP: 43-04934

17 December 2021

Moniteau School District
 Attn: Jeffrey Campbell
 1810 West Sunbury Road
 West Sunbury, PA 16061

Work Order: 1121592
Project: Drinking Water Moniteau Jr/Sr - Weekly
Project Description: Drinking Water

Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
803 Admin Sink	1121592-01	Drinking Water	12/16/2021 11:20	12/16/21 13:30	

Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

Definitions

RL Reporting Limit

Certifications

Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.

Approved By

Sierra Grguric
 Oil & Gas Field Supervisor/Project Manager



1803 Philadelphia Street
Indiana, PA 15701
P: (724) 463-8378
F: (724) 465-4209
PADEP: 32-00382

1276 Bentleyville Road
Van Voorhis, PA 15366
P: (724) 258-8378
F: (724) 258-8376
PADEP: 63-04247

435 Broad Street
Montoursville, PA 17754
P: (570) 321-9002
F: (570) 321-1957
PADEP: 41-04880

950 West Main Street
Sharpsville, PA 16150
P: (724) 463-8378 x 500
F: (724) 465-4209
PADEP: 43-04934

Moniteau School District
1810 West Sunbury Road
West Sunbury, PA 16061

Reported: 12/17/2021 14:46

Lab Sample ID#: 1121592-01
Sample Type: Drinking Water
Sample Source: Grab
Sampler: Paul Somogyi
Client Sample ID: 803 Admin Sink

Sample Date: 12/16/2021 11:20
Receipt Date: 12/16/2021 13:30

Analyte	Sample Result	Units	Data Qualifier	RL	Analyst/ Certification	Prep Date/Time	Analysis Date/Time
Field Analysis	Analytical Method: SM4500-Cl G-11		Prep Method: No Prep - Field				
Chlorine, Free	0.550	mg/L		0.200	PS	12/16/21 11:20	12/16/21 11:20

ENVIRONMENTAL SERVICE LABORATORIES, INC.

SAMPLE REQUEST & CHAIN OF CUSTODY

3E 1 OF 1

HEADQUARTER 1803 Philadelphia St. Indiana, PA 15701 (724) 463-TEST FAX: (724) 465-4209	1276 Bentley Van Voorhis, (724) 258-TE FAX: (724) 2	NORTHWEST DIVISION 950 Main Street Sharpville, PA 16 (724) 463-TEST FAX: (724) 465-4209
---	--	---

Sample Identification	ESL #	Sample Type		Matrix	# of Bottles	Field	Container Type Preservative	Analysis Requested
		Grab	Time					
Distribution: <u>803</u>	<u>1121592</u>	<u>01</u>	<u>01</u>	DW			Field	Free Chlorine <u>.55</u> mg/L

ROTATION	
Wk 1 - 704 Kitchen Sink	
Wk 2 - 802 Room 204 Sink	
Wk 3 - 803 Admin Sink	
Wk 4 - 804 400 Hall RR Sink	
Wk 5 - 804 400 Hall RR Sink	

THE UNDERSIGNED PURCHASER HEREBY AGREES TO PAY SERVICE CHARGES ON ACCOUNTS OVER 31 DAYS OLD

1. THESE SERVICE CHARGES WILL ACCRUE AT THE RATE OF 1 1/2% PER MONTH (18% PER ANNUM OR THE MAXIMUM ALLOWED BY LAW.)

2. THE UNDERSIGNED PURCHASER AGREES TO PAY, IN THE EVENT HIS ACCOUNT BECOMES DELINQUENT AND IS TURNED OVER TO ANY ATTORNEY FOR COLLECTION, REASONABLE ATTORNEY'S FEES PLUS ALL COURT AND ATTENDANT COLLECTION COSTS.

Drinking Water Moniteau Jr/Sr - Weekly

Notes/Special Instructions:

Company/Name: **MONITEAU SCHOOL DISTRICT**

Address: **391 HOOKER ROAD
WEST SUNBURY, PA 16061
JEFFREY CAMPBELL**

Contact Person: **724-406-4426**

Phone Number: **jcambbell@moniteau.org**

Cell Phone: **5100324**

Email Address: **5100324**

Billing Address: **5100324**

PWSID: **5100324**

Department of Environmental Protection

E-Government Application for Drinking Water
Program
SAFE DRINKING WATER ACT
VIEW/EDIT RECORDS

5100324: MONTEAU JR/SR HIGH SCHOOL

SDWA1

PWSID	Contam ID	Contam	Analysis Method	Result	Analysis Date	Location ID 1	Location ID 2	Sample Date	Sample Type	Sample Time	Lab ID	Sample ID	Record ID
5100324	1013	FREE CHLORINE	301	0.61	120921	704		120921	D	1225	32382	1120973-01	BROWNKA_95
5100324	1013	FREE CHLORINE	301	0.74	120221	802		120221	D	1215	32382	1120325-01	BROWNKA_93
5100324	3100	TOTAL COLIFORM PRESENCE	331	0.0	120321	802		120221	D	1215	32382	1120325-01	BROWNKA_94
5100324	1013	FREE CHLORINE	301	0.55	121621	803		121621	D	1120	32382	1121592-01	BROWNKA_873



1803 Philadelphia Street
 Indiana, PA 15701
 P: (724) 463-8378
 F: (724) 465-4209
 PADEP: 32-00382

1276 Bentleyville Road
 Van Voorhis, PA 15366
 P: (724) 258-8378
 F: (724) 258-8376
 PADEP: 63-04247

435 Broad Street
 Montoursville, PA 17754
 P: (570) 321-9002
 F: (570) 321-1957
 PADEP: 41-04880

950 West Main Street
 Sharpsville, PA 16150
 P: (724) 463-8378 x 500
 F: (724) 465-4209
 PADEP: 43-04934

22 December 2021

Moniteau School District
 Attn: Jeffrey Campbell
 1810 West Sunbury Road
 West Sunbury, PA 16061

Work Order: 1121860
Project: Drinking Water Moniteau Jr/Sr - Weekly
Project Description: Drinking Water

Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
804 400 Hall RR Sink	1121860-01	Drinking Water	12/20/2021 08:50	12/20/21 15:11	

Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

Definitions

RL Reporting Limit

Certifications

Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.

Approved By

Carrie Sutton-White
 Project Manager



1803 Philadelphia Street
Indiana, PA 15701
P: (724) 463-8378
F: (724) 465-4209
PADEP: 32-00382

1276 Bentleyville Road
Van Voorhis, PA 15366
P: (724) 258-8378
F: (724) 258-8376
PADEP: 63-04247

435 Broad Street
Montoursville, PA 17754
P: (570) 321-9002
F: (570) 321-1957
PADEP: 41-04880

950 West Main Street
Sharpsville, PA 16150
P: (724) 463-8378 x 500
F: (724) 465-4209
PADEP: 43-04934

Moniteau School District
1810 West Sunbury Road
West Sunbury, PA 16061

Reported: 12/22/2021 14:54

Lab Sample ID#: 1121860-01
Sample Type: Drinking Water
Sample Source: Grab
Sampler: Paul Somogyi
Client Sample ID: 804 400 Hall RR Sink

Sample Date: 12/20/2021 08:50
Receipt Date: 12/20/2021 15:11

Analyte	Sample Result	Units	Data Qualifier	RL	Analyst/ Certification	Prep Date/Time	Analysis Date/Time
Field Analysis	Analytical Method: SM4500-Cl G-11		Prep Method: No Prep - Field				
Chlorine, Free	0.800	mg/L		0.200	PS	12/20/21 08:50	12/20/21 08:50

5100324: MONITEAU JR/SR HIGH SCHOOL

SDWA1

PWSID	Contam ID	Contam	Analysis Method	Result	Analysis Date	Location ID 1	Location ID 2	Sample Date	Sample Type	Sample Time	Lab ID	Sample ID	Record ID
5100324	1013	FREE CHLORINE	301	0.61	120921	704		120921	D	1225	32382	1120973-01	BROWNKA_95
5100324	1013	FREE CHLORINE	301	0.74	120221	802		120221	D	1215	32382	1120325-01	BROWNKA_93
5100324	3100	TOTAL COLIFORM PRESENCE	331	0.0	120321	802		120221	D	1215	32382	1120325-01	BROWNKA_94
5100324	1013	FREE CHLORINE	301	0.55	121621	803		121621	D	1120	32382	1121592-01	BROWNKA_873
5100324	1013	FREE CHLORINE	301	0.8	122021	804		122021	D	0850	32382	1121860-01	BROWNKA_1035

ENVIRONMENTAL SERVICE LABORATORIES, INC.

HEADQUARTER
1803 Philadelphia St.
Indiana, PA 15701
(724) 463-TEST
FAX: (724) 465-4209

SOUTHERN DIVISION
1276 Bentleyville Road
Van Voorhis, PA 15366
(724) 258-TEST
FAX: (724) 258-8376



1121860

NORTHWEST DIVISION
950 Main Street
Sharpshville, PA 16
(724) 463-TEST
FAX: (724) 465-4209



SAMPLE REQUEST & CHAIN OF CUSTODY

3E 1 OF 1

FOR INTERNAL LABORATORY USE ONLY

Sample Identification	ESL#	Sample Type		Matrix	# of Bottles	Container Type	Analysis Requested
		Date	Time				
Distribution: 804	1121860	12/21	0800	DW	Field	Field	Free Chlorine 1.80 mg/L
<p>ROTATION</p> <p>Wk 1 - 704 Kitchen Sink</p> <p>Wk 2 - 802 Room 204 Sink</p> <p>Wk 3 - 803 Admin Sink</p> <p>Wk 4 - 804 400 Hall RR Sink</p> <p>Wk 5 - 804 400 Hall RR Sink</p>							

THE UNDERSIGNED PURCHASER HEREBY AGREES TO PAY SERVICE CHARGES ON ACCOUNTS OVER 31 DAYS OLD.

- THESE SERVICE CHARGES WILL ACCRUE AT THE RATE OF 1 1/2% PER MONTH (18% PER ANNUM OR THE MAXIMUM ALLOWED BY LAW.)
- THE UNDERSIGNED PURCHASER AGREES TO PAY, IN THE EVENT HIS ACCOUNT BECOMES DELINQUENT AND IS TURNED OVER TO ANY ATTORNEY FOR COLLECTION, REASONABLE ATTORNEY'S FEES PLUS ALL COURT AND ATTENDANT COLLECTION COSTS.

Notes/Special Instructions:

Drinking Water Moniteau Jr/Sr - Weekly

Sampled By: (Signature)	Date/ Time	Received By: (Signature)	Date/ Time
	12/21/08 0850		12/20/21 1511
Relinquished By: (Signature)	Date/ Time	Received By: (Signature)	Date/ Time
	12/20/08 1500		12/20/21 1511
Relinquished By: (Signature)	Date/ Time	Received By: (Signature)	Date/ Time

Company/Name: MONITEAU SCHOOL DISTRICT
 Address: 391 HOOKER ROAD
 WEST SUNBURY, PA 16061
 Contact Person: JEFFREY CAMPBELL
 Phone Number: 724-406-4426
 Cell Phone: jcampbell@moniteau.org
 Email Address: jcampbell@moniteau.org
 Billing Address: 5100324
 PWSID: 5100324

Correct Preservations Y / N / NA Correct Containers Y / N / NA Receipt Temperature



1803 Philadelphia Street
 Indiana, PA 15701
 P: (724) 463-8378
 F: (724) 465-4209
 PADEP: 32-00382

1276 Bentleyville Road
 Van Voorhis, PA 15366
 P: (724) 258-8378
 F: (724) 258-8376
 PADEP: 63-04247

435 Broad Street
 Montoursville, PA 17754
 P: (570) 321-9002
 F: (570) 321-1957
 PADEP: 41-04880

950 West Main Street
 Sharpsville, PA 16150
 P: (724) 463-8378 x 500
 F: (724) 465-4209
 PADEP: 43-04934

28 December 2021

Moniteau School District
 Attn: Jeffrey Campbell
 1810 West Sunbury Road
 West Sunbury, PA 16061

Work Order: 1122274
Project: Drinking Water Moniteau Jr/Sr - Weekly
Project Description: Drinking Water

Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
804 400 Hall RR Sink	1122274-01	Drinking Water	12/27/2021 08:55	12/27/21 15:29	

Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

Definitions

RL Reporting Limit

Certifications

Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.

Approved By

Carrie Sutton-White
 Project Manager



1803 Philadelphia Street
Indiana, PA 15701
P: (724) 463-8378
F: (724) 465-4209
PADEP: 32-00382

1276 Bentleyville Road
Van Voorhis, PA 15366
P: (724) 258-8378
F: (724) 258-8376
PADEP: 63-04247

435 Broad Street
Montoursville, PA 17754
P: (570) 321-9002
F: (570) 321-1957
PADEP: 41-04880

950 West Main Street
Sharpsville, PA 16150
P: (724) 463-8378 x 500
F: (724) 465-4209
PADEP: 43-04934

Moniteau School District
1810 West Sunbury Road
West Sunbury, PA 16061

Reported: 12/28/2021 18:32

Lab Sample ID#: 1122274-01
Sample Type: Drinking Water
Sample Source: Grab
Sampler: Paul Somogyi
Client Sample ID: 804 400 Hall RR Sink

Sample Date: 12/27/2021 08:55
Receipt Date: 12/27/2021 15:29

Analyte	Sample Result	Units	Data Qualifier	RL	Analyst/ Certification	Prep Date/Time	Analysis Date/Time
Field Analysis	Analytical Method: SM4500-Cl G-11			Prep Method: No Prep - Field			
Chlorine, Free	0.730	mg/L		0.200	PS	12/27/21 08:55	12/27/21 08:55

ENVIRONMENTAL SERVICE LABORATORIES, INC.

HEADQUARTER
1803 Philadelphia St.
Indiana, PA 15701
(724) 463-TEST
FAX: (724) 465-4209

SOUTHERN DIVISION
1276 Bentleyville Road
Van Voorhis, PA 15366
(724) 258-TEST
FAX: (724) 258-8376

NORTHWEST DIVISION
950 Main Street
Sharpsville, PA 16
(724) 463-TEST
FAX: (724) 465-4209

1122274
FAX: (570) 321-1957
FOR INTERNAL LABORATORY USE ONLY

CHAIN OF CUSTODY

Page 3 of 4

Sample Identification	ESL#	Sample Type		Matrix	# of Bottles	Container Type Preservative	Analysis Requested
		Date	Time				
Distribution: <u>SOL</u>	<u>1122274</u>	<u>12-27-11</u>	<u>0855</u>	DW	Field	Field	Free Chlorine <u>7.3</u> mg/L
<p>ROTATION</p> <p>Wk 1 - 704 Kitchen Sink</p> <p>Wk 2 - 802 Room 204 Sink</p> <p>Wk 3 - 803 Admin Sink</p> <p>Wk 4 - 804 400 Hall RR Sink</p> <p>Wk 5 - 804 400 Hall RR Sink</p>							
<p>THE UNDERSIGNED PURCHASER HEREBY AGREES TO PAY SERVICE CHARGES ON ACCOUNTS OVER 31 DAYS OLD.</p> <p>1. THESE SERVICE CHARGES WILL ACCRUE AT THE RATE OF 1 1/2% PER MONTH (18% PER ANNUM OR THE MAXIMUM ALLOWED BY LAW.)</p> <p>2. THE UNDERSIGNED PURCHASER AGREES TO PAY, IN THE EVENT HIS ACCOUNT BECOMES DELINQUENT AND IS TURNED OVER TO ANY ATTORNEY FOR COLLECTION, REASONABLE ATTORNEY'S FEES PLUS ALL COURT AND ATTENDANT COLLECTION COSTS.</p>							
Sampled By: (Signature) <u>[Signature]</u> Date/ Time <u>12-27-11 0855</u>		Received By: (Signature) <u>[Signature]</u> Date/ Time <u>12-27-11 1530</u>		Notes/Special Instructions: <u>Drinking Water Moniteau Jr/Sr - Weekly</u>			
Relinquished By: (Signature) <u>[Signature]</u> Date/ Time <u>12-27-11 0855</u>		Received By: (Signature) <u>[Signature]</u> Date/ Time <u>12-27-11 1530</u>		Company Name: <u>MONITEAU SCHOOL DISTRICT</u>			
Relinquished By: (Signature) <u>[Signature]</u> Date/ Time <u>12-27-11 0855</u>		Received By: (Signature) <u>[Signature]</u> Date/ Time <u>12-27-11 1530</u>		Address: <u>391 HOOKER ROAD</u>			
Relinquished By: (Signature) <u>[Signature]</u> Date/ Time <u>12-27-11 0855</u>		Received By: (Signature) <u>[Signature]</u> Date/ Time <u>12-27-11 1530</u>		Contact Person: <u>JEFFREY CAMPBELL</u>			
Correct Preservations <u>Y / N / NA</u>		Correct Containers <u>Y / N / NA</u>		Phone Number: <u>724-406-4426</u>			
Receipt Temperature <u> </u>		Receipt Temperature <u> </u>		Cell Phone: <u>jcampbell@moniteau.org</u>			
Correct Preservations <u>Y / N / NA</u>		Correct Containers <u>Y / N / NA</u>		Billing Address: <u>WEST SUNBURY, PA 16061</u>			
Receipt Temperature <u> </u>		Receipt Temperature <u> </u>		PWSID: <u>5100324</u>			

5100324: MONITEAU JR/SR HIGH SCHOOL

SDWA1

PWSID	Contam ID	Contam	Analysis Method	Result	Analysis Date	Location ID 1	Location ID 2	Sample Date	Sample Type	Sample Time	Lab ID	Sample ID	Record ID
5100324	1013	FREE CHLORINE	301	0.61	120921	704		120921	D	1225	32382	1120973-01	BROWNKA_95
5100324	1013	FREE CHLORINE	301	0.74	120221	802		120221	D	1215	32382	1120325-01	BROWNKA_93
5100324	3100	TOTAL COLIFORM PRESENCE	331	0.0	120321	802		120221	D	1215	32382	1120325-01	BROWNKA_94
5100324	1013	FREE CHLORINE	301	0.55	121621	803		121621	D	1120	32382	1121592-01	BROWNKA_873
5100324	1013	FREE CHLORINE	301	0.8	122021	804		122021	D	0850	32382	1121860-01	BROWNKA_1035
5100324	1013	FREE CHLORINE	301	0.73	122721	804		122721	D	0855	32382	1122274-01	BROWNKA_1182

**Moniteau School District
Maintenance Department
Moniteau High School
Wastewater Treatment Facility
Monthly Operations Report
December 2021**



COMMONWEALTH OF PENNSYLVANIA
DEPARTMENT OF ENVIRONMENTAL PROTECTION
BUREAU OF CLEAN WATER

DISCHARGE MONITORING REPORT (DMR)

NAME: MONITEAU SCH DIST
 ADDRESS: 1810 W SUNBURY RD, WEST SUNBURY, PA, 16061-1220
 FACILITY: MONITEAU JR SR HIGH SCHOOL
 LOCATION: 1810 W SUNBURY RD, WEST SUNBURY, PA, 16061-1220
 STAGE: Final Effluent

PA0091341
PERMIT NUMBER

001
OUTFALL NUMBER

Reporting Frequency: Monthly
 DMR Effective From: 12/01/2021
 DMR Effective To: 12/31/2021
 Permit Expires: 05/31/2022
 Permit Application Due: 12/02/2021
 No Discharge:

MONITORING PERIOD					
YEAR	MO	DAY	YEAR	MO	DAY
2021	12	01	2021	12	31

FROM

PARAMETER	SAMPLE MEASUREMENT	QUANTITY OR LOADING		QUANTITY OR CONCENTRATION		SAMPLING FREQUENCY	SAMPLING TYPE
		VALUE	UNITS	VALUE	UNITS		
Dissolved Oxygen (00300)	SAMPLE MEASUREMENT	6.20	***	6.20	***	1/week	Grab
	PERMIT REQUIREMENT	4.0	***	Min	***	1/week	Grab
pH (00400)	SAMPLE MEASUREMENT	6.25	***	6.25	7.20	1/week	Grab
	PERMIT REQUIREMENT	6.0	***	Min	9.0	1/week	Grab
Total Suspended Solids (00530)	SAMPLE MEASUREMENT	<5.0	***	<5.0	***	2/month	Grab
	PERMIT REQUIREMENT	30	***	Avg Mo	***	2/month	Grab
Total Nitrogen (00600)	SAMPLE MEASUREMENT	27.85	***	27.85	***	2/month	Grab
	PERMIT REQUIREMENT	Monitor & Report	***	Avg Mo	***	2/month	Grab
Total Phosphorus (00665)	SAMPLE MEASUREMENT	2.35	***	2.35	***	2/month	Grab
	PERMIT REQUIREMENT	Monitor & Report	***	Avg Mo	***	2/month	Grab
Ultraviolet light intensity (49607)	SAMPLE MEASUREMENT	5.58	***	5.58	***	1/week	Grab
	PERMIT REQUIREMENT	Monitor & Report	***	Avg Mo	***	1/week	Grab
Flow (50050)	SAMPLE MEASUREMENT	.002918	***	***	***	1/week	Measured
	PERMIT REQUIREMENT	Monitor & Report	***	MGD	***	1/week	Measured

DISCHARGE MONITORING REPORT (DMR)

PARAMETER	SAMPLE MEASUREMENT	QUANTITY OR LOADING			QUANTITY OR CONCENTRATION				SAMPLING FREQUENCY	SAMPLING TYPE
		VALUE	UNITS	UNITS	VALUE	VALUE	VALUE	UNITS		
Fecal Coliform (74055)	SAMPLE MEASUREMENT	***	***		***	<1.0	<1.0	No./100 ml	2/month	Grab
	PERMIT REQUIREMENT	***	***		***	2000 Geo Mean	10000 IMAX		2/month	Grab
Carbonaceous Biochemical Oxygen Demand (CBOD5) (80082)	SAMPLE MEASUREMENT	***	***		***	2.93	***	mg/L	2/month	Grab
	PERMIT REQUIREMENT	***	***		***	25 Avg Mo	***		2/month	Grab
Facility Comments										

COMMENT DETAILS

COMMENTS	OPERATOR NAME	OPERATOR CERTIFICATION NUMBER	OPERATOR CONTACT NUMBER



JEFFREY CAMPBELL <jcampbell@moniteau.org>

Your eDMR Report Has Been Received For Permit No. PA0091341

1 message

depgreenporthelpdesk@state.pa.us <depgreenporthelpdesk@state.pa.us>
To: jcampbell@moniteau.org, mcafoose92@hotmail.com

Thu, Jan 6, 2022 at 1:43 PM

This email is to confirm that the following report was received by DEP through the eDMR system:

Facility Name: MONITEAU JR SR HIGH SCHOOL
Permit Number: PA0091341
Report Frequency: Monthly
Report Type: DMR
Reporting Period: 12/01/2021-12/31/2021
Report Due Date: 01/28/2022


Submitted By: Jeffrey Campbell
Submission Id: 303494
Submission Status: Received
Submission Type: Original

To view the details of this report, access the eDMR system through DEP's [GreenPort](#) and select the link for View/Revise Submitted.

Moniteau High School Sewage Treatment Plant				Daily Operations Worksheet					
Permit # PA0091341				DEC 2021					
Date	Day	#1 PH	#1 DO	#2 PH	#2 DO	UV	Meter Reading	Time	Operator
12/1	Wed	6.42	10.82	6.88	11.11	5.0	5,426,157	7:00 AM	Jeff C
12/2	Thurs	6.35	10.73	6.90	11.17	5.0		8:00 AM	Jeff C
12/3	Fri	6.40	10.02	6.88	10.51	5.4		8:00 AM	Jeff C
12/4	Mon	6.45	9.72	AERATION		5.7		8:00 AM	Jeff C
12/7	Tues	6.53	6.61	6.80	6.20	5.4		1:00 PM	Jeff C
12/8	Wed	6.59	8.80	7.16	6.40	5.2		3:30 PM	Jeff C
12/9	Thurs	6.58	8.75	7.20	6.45	5.4		1:30 PM	Jeff C
12/10	Fri	6.60	8.72	7.20	6.42	5.7		3:00 PM	Jeff C
12/13	Mon	6.59	9.98	7.12	9.72	5.5		1:00 PM	Jeff C
12/14	Tues	6.50	10.99	6.97	10.31	5.1		8:00 AM	Jeff C
12/15	Wed	6.51	9.74	7.04	6.22	6.1		10:30 AM	Jeff R.
12/16	Thurs	6.36	8.11	6.50	6.57	6.3		11:00 AM	Jeff R.
12/17	Fri	6.31	8.95	6.92	6.84	6.5		11:00 AM	Jeff R.
12/20	Mon	6.25	9.05	7.01	6.97	5.5		9:30 AM	Jeff C
12/21	Tues	6.28	9.81	6.45	9.99	5.3		8:00 AM	Jeff C
12/22	Wed	6.30	9.85	6.50	10.01	5.7		8:00 AM	Jeff C
12/23	Thurs	6.45	9.93	6.56	10.21	5.5		9:15 AM	Jeff C
12/24	Fri	6.47	9.97	6.60	10.28	5.5		5:00 AM	Jeff C
12/27	Mon	6.53	10.42	6.65	10.37	5.3		7:30 AM	Jeff C
12/28	Tues	6.60	10.49	AERATION		5.3		8:30 AM	Jeff C
12/29	Wed	6.71	10.21	6.84	10.01	5.9		8:30 A	Jeff C
12/30	Thurs	6.75	10.10	7.00	9.28	6.0		8:30 A	Jeff C
12/31	Fri	6.83	9.93	7.37	8.70	6.0	5,576,621	8:30 A	Jeff C
	PH		DO			128.5	90,464	- 31 =	2918 Daily Avg.
	Low	6.25	Low	6.20		- 23 =			
	High	7.20	High	11.17		5.58	Daily Avg.		

* TEST DAY

* TEST DAY

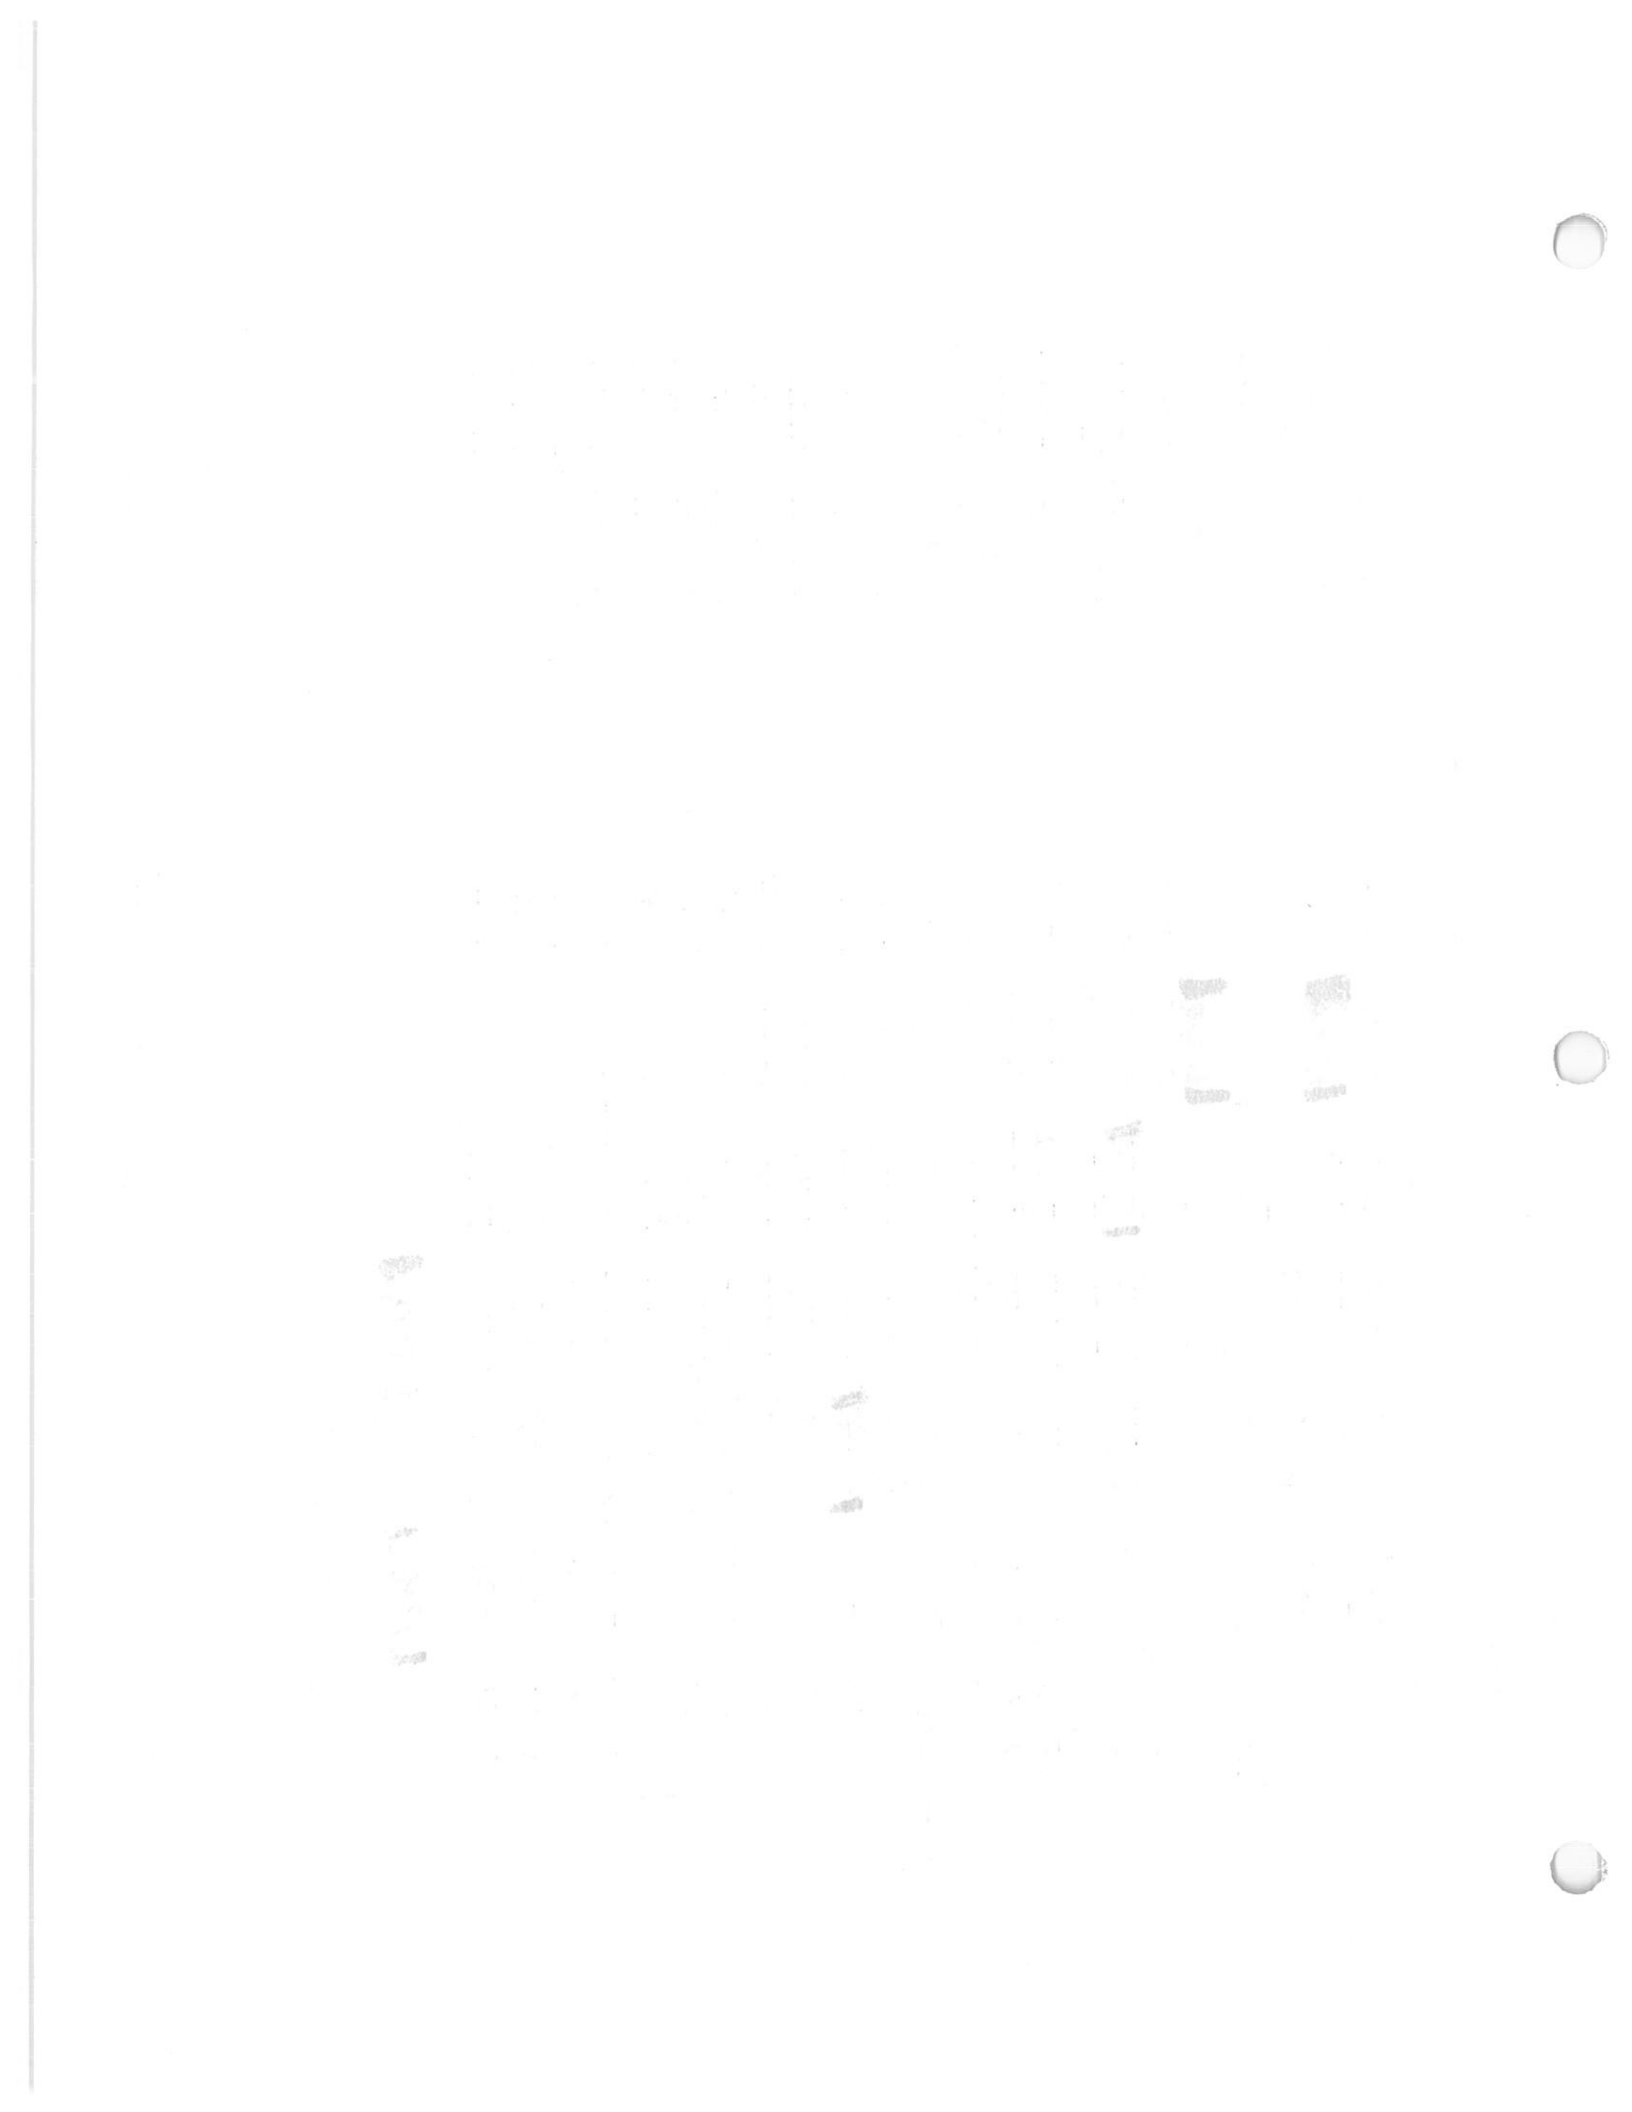

Moniteau School District
 High School WASTE WATER TREATMENT PLANT
 Monthly OPERATIONS WORK SHEET
 December 2021

	12/2	12/16	TOTAL	AUG.
TOTAL Nitrogen	17.6 +	38.1	$55.7 \div 2 =$	27.85
TOTAL Suspended Solids	< 5 +	< 5	... < 5	< 5
TOTAL K-Nitrogen	1.02 +	0.819	$1.839 \div 2 =$	0.919
Nitrate / Nitrite	16.5 +	37.3	$53.8 \div 2 =$	26.9
Phosphorus	1.1 +	3.6	$4.7 \div 2 =$	2.35
CBOD	3.85 +	< 2.00	$5.85 \div 2 =$	2.925
Fecal Coliforms	< 1 +	< 1	< 1	< 1

Flow $90,464 \div 31 \text{ DAY'S} = 2918 \text{ Daily Aug.}$

U.V. Light $128.5 \div 23 \text{ DAY'S} = 5.58 \text{ Daily Aug.}$

PH Low 6.25 #1 BASIN 12/20

High 7.20 #2 BASIN 12/19

D.O. Low 6.20 #2 BASIN 12/17

High 11.17 #2 BASIN 12/2

Montana School District

High School Water Treatment Plant

Monthly Operating Cost Sheet


December 2011

Aug	Total	12/1	12/2	Total
27.82	22.7 = 3	17.6 + 38.1	17.6 + 38.1	Total High School
< 2	1.838 = 2	< 2 + < 2	< 2 + < 2	Total 2nd High School
0.010	1.838 = 3	1.00 + 0.010	1.00 + 0.010	Total K-12
26.0	23.8 = 3	16.2 + 37.3	16.2 + 37.3	Utilities / Materials
2.02	4.7 = 3	1.1 + 3.6	1.1 + 3.6	Personnel
2.932	2.22 = 1	3.82 + 2.00	3.82 + 2.00	Chemical
< 1	< 1	< 1 + < 1	< 1 + < 1	Total

90% = 31 Days = 2018 Daily Avg.

138.2 = 33 Days = 208 Daily Avg.

High	12/1	# 1 Basin	12/2	# 2 Basin
11.17	1.90	# 2 Basin 12/1	2.90	# 2 Basin 12/2
1.90	1.90	# 2 Basin 12/1	1.90	# 2 Basin 12/2
1.90	1.90	# 2 Basin 12/1	1.90	# 2 Basin 12/2
1.90	1.90	# 2 Basin 12/1	1.90	# 2 Basin 12/2

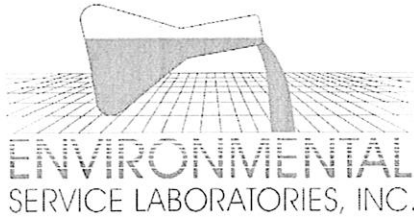

1803 Philadelphia Street
Indiana, PA 15701
P: (724) 463-8378
F: (724) 465-4209
PADEP: 32-00382

1276 Bentleyville Road
Van Voorhis, PA 15366
P: (724) 258-8378
F: (724) 258-8376
PADEP: 63-04247

435 Broad Street
Montoursville, PA 17754
P: (570) 321-9002
F: (570) 321-1957
PADEP: 41-04880

950 West Main Street
Sharpsville, PA 16150
P: (724) 463-8378 x 500
F: (724) 465-4209
PADEP: 43-04934

27 December 2021

Moniteau School District
Attn: Jeffrey Campbell
1810 West Sunbury Road
West Sunbury, PA 16061

Work Order: 1121586
Project: Wastewater
Project Description: Wastewater

Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
Effluent Outfall 001	1121586-01	Waste Water	12/16/2021 11:00	12/16/21 13:30	

Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

Definitions

- G CBOD / BOD result may be biased low due to GGA standard falling below laboratory acceptance criteria.
- BB Dilution water blank exceeded method acceptance criteria of 0.20 mg/L DO loss.
- RL Reporting Limit
- CFU Colony Forming Units


Certifications

Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.
Environmental Service Laboratories, Inc., Indiana, PA/TNI Certification #32-00382

Approved By

Sierra Grguric
Oil & Gas Field Supervisor/Project Manager



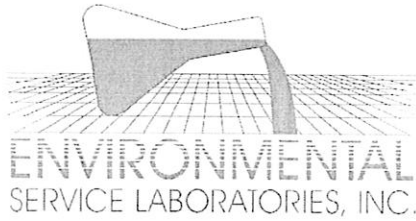

1803 Philadelphia Street
 Indiana, PA 15701
 P: (724) 463-8378
 F: (724) 465-4209
 PADEP: 32-00382

1276 Bentleyville Road
 Van Voorhis, PA 15366
 P: (724) 258-8378
 F: (724) 258-8376
 PADEP: 63-04247

435 Broad Street
 Montoursville, PA 17754
 P: (570) 321-9002
 F: (570) 321-1957
 PADEP: 41-04880

950 West Main Street
 Sharpsville, PA 16150
 P: (724) 463-8378 x 500
 F: (724) 465-4209
 PADEP: 43-04934

Moniteau School District
 1810 West Sunbury Road
 West Sunbury, PA 16061

Reported: 12/27/2021 11:17

Lab Sample ID#: 1121586-01
 Sample Type: Waste Water
 Sample Source: Grab
 Sampler: Jeffrey Campbell
 Client Sample ID: Effluent Outfall 001

Sample Date: 12/16/2021 11:00
 Receipt Date: 12/16/2021 13:30

Analyte	Sample Result	Units	Data Qualifier	RL	Analyst/ Certification	Prep Date/Time	Analysis Date/Time
General Chemistry	Analytical Method: CALC				Prep Method: [CALC]		
Total Nitrogen	38.1	mg/L		1.66	DAA	12/21/21 13:04	12/21/21 13:04
General Chemistry	Analytical Method: SM2540 D-11				Prep Method: No Prep - WetChem		
Total Suspended Solids	<5	mg/L		5	LMB	12/21/21 13:15	12/21/21 16:40
General Chemistry	Analytical Method: SM4500 NH3 F-11				Prep Method: SM 4500-Norg B		
Total Kjeldahl Nitrogen	0.819	mg/L		0.625	DAA	12/19/21 12:30	12/20/21 14:57
General Chemistry	Analytical Method: SM4500-NO3 E-11 (discrete)				Prep Method: No Prep - WetChem		
Nitrate/Nitrite	37.3	mg/L		1.04	AW	12/21/21 13:04	12/21/21 13:04
General Chemistry	Analytical Method: SM4500-P E-11				Prep Method: No Prep - WetChem		
Phosphorus	3.6	mg/L		0.50	AW	12/23/21 12:05	12/23/21 12:05
General Chemistry	Analytical Method: SM5210 B-11				Prep Method: No Prep - WetChem		
Carbonaceous Biochemical Oxygen Demand	<2.00	mg/L	BB, G	2.00	AS	12/17/21 16:30	12/22/21 10:30
Microbiology	Analytical Method: Colilert-18				Prep Method: No Prep - Micro		
Fecal Coliforms	<1	MPN/100 mL		1	KD	12/16/21 14:36	12/17/21 09:39



SAMPLE RECEIPT AND REVIEW FORM

Client: <u>Monahan</u>	Work 1121586 re)
------------------------	--

PART A: GENERAL INFORMATION- SATELLITE LABORATORY

Received by/Lab ID: _____	Date/Time Received: / / _____
Method of Delivery: Client Drop-Off <input type="checkbox"/> ESL Courier <input type="checkbox"/> Other: _____	Received on Ice? YES <input type="checkbox"/> NO <input type="checkbox"/>
Sample Receipt Temperature: _____ °C	IR Gun ID: _____
Containers Removed by Satellite Lab for Analysis of: FECAL <input type="checkbox"/> TC/EC <input type="checkbox"/> TC MPN <input type="checkbox"/> EC MPN <input type="checkbox"/> TC/EC MPN <input checked="" type="checkbox"/> N/A	

PART B: GENERAL INFORMATION- INDIANA LABORATORY

Received by/Lab ID: <u>SPM40038</u>	Samples Received on Ice? YES <input checked="" type="checkbox"/> NO <input type="checkbox"/>
Date/Time Received: <u>12/16/21 1330</u>	Date Sampled: <u>12/16/21</u>
Method of Delivery: FedEx <input type="checkbox"/> UPS <input type="checkbox"/> Client Drop off <input type="checkbox"/> <u>ESL courier</u> <input checked="" type="checkbox"/> Other: _____	
Sample Receipt Temperature: <u>3.9</u> °C	IR Gun ID: <u>4</u>
Sample State of Collection: PA <input checked="" type="checkbox"/> NY <input type="checkbox"/> OH <input type="checkbox"/> WV <input type="checkbox"/> Other: _____	PWSID Compliance Drinking Water Samples: YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>

PART C: Receipt Details Completed (if different from above): _____ / / _____

Sample Receipt Criteria			Comments/Qualifiers (Required for Non-Conforming Items)		
Chain of custody documents included with samples?	YES	NO	Comments:		
COC form is properly signed in relinquished/received sections?	YES	NO	Comments:		
Sample containers intact and sealed?	YES	NO	Circle Applicable: Damaged Container <input type="checkbox"/> Leaking Container <input type="checkbox"/> Custody Seal Broken <input type="checkbox"/> Other: _____		
Number of containers received matches number indicated on COC?	YES	NO	Sample IDs and Containers Affected:		
Sample IDs on COC match IDs on bottles?	YES	NO	Sample IDs and Containers Affected:		
Date and time on COC match date and time on bottles?	YES	NO	Sample IDs and Containers Affected:		
Samples received within holding time?	YES	NO	Sample IDs and Containers Affected:		
Samples received at appropriate pH for analysis requested?	YES	NO	Sample IDs and Containers Affected and Observed pH:		
Samples requiring thermal preservation within 0 ≤ 6°C? Microbiology within 0 ≤ 10°C?	YES	NO	For non-WV samples outside of thermal preservation range sampled same day and received on ice are considered acceptable as long as the cooling process has begun.		
Adequate sample volume received?	YES	NO	Analyses Affected:		
VOA vials free of headspace (defined as < 6 mm bubble)?	YES	NO	Sample IDs and Containers Affected:		
Other Comments:				Deficiency Log Created: YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	

Effective Date:



1803 Philadelphia Street
Indiana, PA 15701
P: (724) 463-8378
F: (724) 465-4209
PADEP: 32-00382

1276 Bentleyville Road
Van Voorhis, PA 15366
P: (724) 258-8378
F: (724) 258-8376
PADEP: 63-04247

435 Broad Street
Montoursville, PA 17754
P: (570) 321-9002
F: (570) 321-1957
PADEP: 41-04880

950 West Main Street
Sharpville, PA 16150
P: (724) 463-8378 x 500
F: (724) 465-4209
PADEP: 43-04934

10 December 2021

Moniteau School District
Attn: Jeffrey Campbell
1810 West Sunbury Road
West Sunbury, PA 16061

Work Order: 1120224
Project: Wastewater
Project Description: Wastewater

Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
Effluent Grab	1120224-01	Waste Water	12/02/2021 11:00	12/2/21 14:20	

Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

Definitions

SS Seed Control did not meet reference method acceptance criteria.
G CBOD / BOD result may be biased low due to GGA standard falling below laboratory acceptance criteria.
RL Reporting Limit
CFU Colony Forming Units

Certifications

Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.
Environmental Service Laboratories, Inc., Indiana, PA/TNI Certification #32-00382

Approved By

Sierra Grguric
Oil & Gas Field Supervisor/Project Manager





1803 Philadelphia Street
 Indiana, PA 15701
 P: (724) 463-8378
 F: (724) 465-4209
 PADEP: 32-00382

1276 Bentleyville Road
 Van Voorhis, PA 15366
 P: (724) 258-8378
 F: (724) 258-8378
 PADEP: 63-04247

435 Broad Street
 Montoursville, PA 17754
 P: (570) 321-9002
 F: (570) 321-1957
 PADEP: 41-04880

950 West Main Street
 Sharpshville, PA 16150
 P: (724) 463-8378 x 500
 F: (724) 465-4209
 PADEP: 43-04934

Moniteau School District
 1810 West Sunbury Road
 West Sunbury, PA 16061

Reported: 12/10/2021 10:25

Lab Sample ID#: 1120224-01
 Sample Type: Waste Water
 Sample Source: Grab
 Sampler: Client
 Client Sample ID: Effluent Grab

Sample Date: 12/02/2021 11:00
 Receipt Date: 12/02/2021 14:20

Analyte	Sample Result	Units	Data Qualifier	RL	Analyst/ Certification	Prep Date/Time	Analysis Date/Time
General Chemistry	Analytical Method: CALC				Prep Method: [CALC]		
Total Nitrogen	17.6	mg/L		1.66	DAA	12/09/21 13:12	12/09/21 13:12
General Chemistry	Analytical Method: SM2540 D-11				Prep Method: No Prep - WetChem		
Total Suspended Solids	<5	mg/L		5	LMB	12/07/21 10:57	12/07/21 13:20
General Chemistry	Analytical Method: SM4500 NH3 F-11				Prep Method: SM 4500-Norg B		
Total Kjeldahl Nitrogen	1.02	mg/L		0.625	DAA	12/06/21 14:10	12/07/21 13:24
General Chemistry	Analytical Method: SM4500-NO3 E-11 (discrete)				Prep Method: No Prep - WetChem		
Nitrate/Nitrite	16.5	mg/L		1.04	AW	12/09/21 13:12	12/09/21 13:12
General Chemistry	Analytical Method: SM4500-P E-11				Prep Method: No Prep - WetChem		
Phosphorus	1.1	mg/L		0.50	AW	12/08/21 13:10	12/08/21 13:10
General Chemistry	Analytical Method: SM5210 B-11				Prep Method: No Prep - WetChem		
Carbonaceous Biochemical Oxygen Demand	3.85	mg/L	G, SS	2.00	AS	12/03/21 14:15	12/08/21 09:30
Microbiology	Analytical Method: Colilert-18				Prep Method: No Prep - Micro		
Fecal Coliforms	<1	MPN/100 mL		1	KD	12/02/21 14:26	12/03/21 11:10



1803 Philadelphia Street
Indiana, PA 15701
P: (724) 463-8378
F: (724) 465-4209
PADEP: 32-00382

1276 Bentleyville Road
Van Voorhis, PA 15366
P: (724) 258-8378
F: (724) 258-8376
PADEP: 63-04247

435 Broad Street
Montoursville, PA 17754
P: (570) 321-9002
F: (570) 321-1957
PADEP: 41-04880

950 West Main Street
Sharpsville, PA 16150
P: (724) 463-8378 x 500
F: (724) 465-4209
PADEP: 43-04934

27 December 2021

Moniteau School District
Attn: Jeffrey Campbell
1810 West Sunbury Road
West Sunbury, PA 16061

Work Order: 1121586
Project: Wastewater
Project Description: Wastewater

Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
Effluent Outfall 001	1121586-01	Waste Water	12/16/2021 11:00	12/16/21 13:30	

Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

Definitions

- G CBOD / BOD result may be biased low due to GGA standard falling below laboratory acceptance criteria.
- BB Dilution water blank exceeded method acceptance criteria of 0.20 mg/L DO loss.
- RL Reporting Limit
- CFU Colony Forming Units

Certifications

Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.
Environmental Service Laboratories, Inc., Indiana, PA/TNI Certification #32-00382

Approved By

Sierra Grguric
Oil & Gas Field Supervisor/Project Manager





1803 Philadelphia Street
Indiana, PA 15701
P: (724) 463-8378
F: (724) 465-4209
PADEP: 32-00382

1276 Bentleyville Road
Van Voorhis, PA 15366
P: (724) 258-8378
F: (724) 258-8376
PADEP: 63-04247

435 Broad Street
Montoursville, PA 17754
P: (570) 321-9002
F: (570) 321-1957
PADEP: 41-04880

950 West Main Street
Sharpsville, PA 16150
P: (724) 463-8378 x 500
F: (724) 465-4209
PADEP: 43-04934

Moniteau School District
1810 West Sunbury Road
West Sunbury, PA 16061

Reported: 12/27/2021 11:17

Lab Sample ID#: 1121586-01
Sample Type: Waste Water
Sample Source: Grab
Sampler: Jeffrey Campbell
Client Sample ID: Effluent Outfall 001

Sample Date: 12/16/2021 11:00
Receipt Date: 12/16/2021 13:30

Analyte	Sample Result	Units	Data Qualifier	RL	Analyst/ Certification	Prep Date/Time	Analysis Date/Time
General Chemistry	Analytical Method: CALC				Prep Method: [CALC]		
Total Nitrogen	38.1	mg/L		1.66	DAA	12/21/21 13:04	12/21/21 13:04
General Chemistry	Analytical Method: SM2540 D-11				Prep Method: No Prep - WetChem		
Total Suspended Solids	<5	mg/L		5	LMB	12/21/21 13:15	12/21/21 16:40
General Chemistry	Analytical Method: SM4500 NH3 F-11				Prep Method: SM 4500-Norg B		
Total Kjeldahl Nitrogen	0.819	mg/L		0.625	DAA	12/19/21 12:30	12/20/21 14:57
General Chemistry	Analytical Method: SM4500-NO3 E-11 (discrete)				Prep Method: No Prep - WetChem		
Nitrate/Nitrite	37.3	mg/L		1.04	AW	12/21/21 13:04	12/21/21 13:04
General Chemistry	Analytical Method: SM4500-P E-11				Prep Method: No Prep - WetChem		
Phosphorus	3.6	mg/L		0.50	AW	12/23/21 12:05	12/23/21 12:05
General Chemistry	Analytical Method: SM5210 B-11				Prep Method: No Prep - WetChem		
Carbonaceous Biochemical Oxygen Demand	<2.00	mg/L	BB, G	2.00	AS	12/17/21 16:30	12/22/21 10:30
Microbiology	Analytical Method: Colilert-18				Prep Method: No Prep - Micro		
Fecal Coliforms	<1	MPN/100 mL		1	KD	12/16/21 14:36	12/17/21 09:39



SAMPLE RECEIPT AND REVIEW FORM

Client: <u>Monteau</u>	Work re) <div style="text-align: center;"> 1121586 </div>
-------------------------------	--

PART A: GENERAL INFORMATION- SATELLITE LABORATORY

Received by/Lab ID:	Date/Time Received: / /
Method of Delivery: Client Drop-Off <input type="checkbox"/> ESL Courier <input type="checkbox"/> Other: _____	Received on Ice? YES <input type="checkbox"/> NO <input type="checkbox"/>
Sample Receipt Temperature: _____ °C	IR Gun ID:
Containers Removed by Satellite Lab for Analysis of: FECAL <input type="checkbox"/> TC/EC <input type="checkbox"/> TC MPN <input type="checkbox"/> EC MPN <input type="checkbox"/> TC/EC MPN <input checked="" type="checkbox"/> (N/A)	

PART B: GENERAL INFORMATION- INDIANA LABORATORY

Received by/Lab ID: <u>SPM100382</u>	Samples Received on Ice? YES <input checked="" type="checkbox"/> NO <input type="checkbox"/>
Date/Time Received: <u>12/16/21 1530</u>	Date Sampled: <u>12/16/21</u>
Method of Delivery: FedEx <input type="checkbox"/> UPS <input type="checkbox"/> Client Drop off <input checked="" type="checkbox"/> <u>ESL-courier</u> Other: _____	
Sample Receipt Temperature: <u>3.4</u> °C	IR Gun ID: <u>4</u>
Sample State of Collection: <input checked="" type="checkbox"/> PA <input type="checkbox"/> NY <input type="checkbox"/> OH <input type="checkbox"/> WV Other: _____	PWSID Compliance Drinking Water Samples: YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>

PART C: Receipt Details Completed (if different from above): _____ / /

Sample Receipt Criteria			Comments/Qualifiers (Required for Non-Conforming Items)
Chain of custody documents included with samples?	YES	NO	Comments:
COC form is properly signed in relinquished/received sections?	YES	NO	Comments:
Sample containers intact and sealed?	YES	NO	Circle Applicable: Damaged Container <input type="checkbox"/> Leaking Container <input type="checkbox"/> Custody Seal Broken <input type="checkbox"/> Other: _____
Number of containers received matches number indicated on COC?	YES	NO	Sample IDs and Containers Affected:
Sample IDs on COC match IDs on bottles?	YES	NO	Sample IDs and Containers Affected:
Date and time on COC match date and time on bottles?	YES	NO	Sample IDs and Containers Affected:
Samples received within holding time?	YES	NO	Sample IDs and Containers Affected:
Samples received at appropriate pH for analysis requested?	YES	NO	Sample IDs and Containers Affected and Observed pH:
Samples requiring thermal preservation within 0 ≤ 6°C? Microbiology within 0 ≤ 10°C?	YES	NO	For non-WV samples outside of thermal preservation range sampled same day and received on ice are considered acceptable as long as the cooling process has begun.
Adequate sample volume received?	YES	NO	Analyses Affected:
VOA vials free of headspace (defined as < 6 mm bubble)?	YES	NO <input checked="" type="checkbox"/>	Sample IDs and Containers Affected:
Other Comments:			Deficiency Log Created: YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>

Effective Date: